
CONSTRUCTION DOCUMENTS

JESSAMINE CO. EMERGENCY SERVICES EXTERIOR RENOVATIONS

101 SOUTH 2ND STREET NICHOLASVILLE, KY 40356

JULY 14, 2023

	DRAWING SHEET INDEX									
	SHEET IDENTIFICATION									
SHEET NUMBER	SHEET NAME									
GI001	COVER SHEET									
AE001	ARCHITECTURAL GENERAL NOTES & SYMBOLS									
AD101	EXISTING FLOOR PLAN									
AD102	EXISTING ROOF PLAN									
AD201	EXISTING EXTERIOR ELEVATIONS									
AD202	EXISTING EXTERIOR ELEVATIONS									
AE101	RENOVATION FLOOR PLAN									
AE102	RENOVATION ROOF PLAN									
AE201	EXTERIOR ELEVATIONS									
AE202	EXTERIOR ELEVATIONS									
AE301	BUILDING SECTIONS									
AE501	DETAILS									
AE601	DOOR SCHEDULE & DETAILS									
E-001	ELECTRICAL STANDARD SYMBOLS									
ED101	ELECTRICAL DEMOLITION FLOOR PLAN									
ED102	ELECTRICAL DEMOLITION ROOF PLAN									
E-101	ELECTRICAL RENOVATION FLOOR PLAN									
E-102	ELECTRICAL RENOVATION ROOF PLAN									
E-501	ELECTRICAL DETAILS AND SCHEDULES									

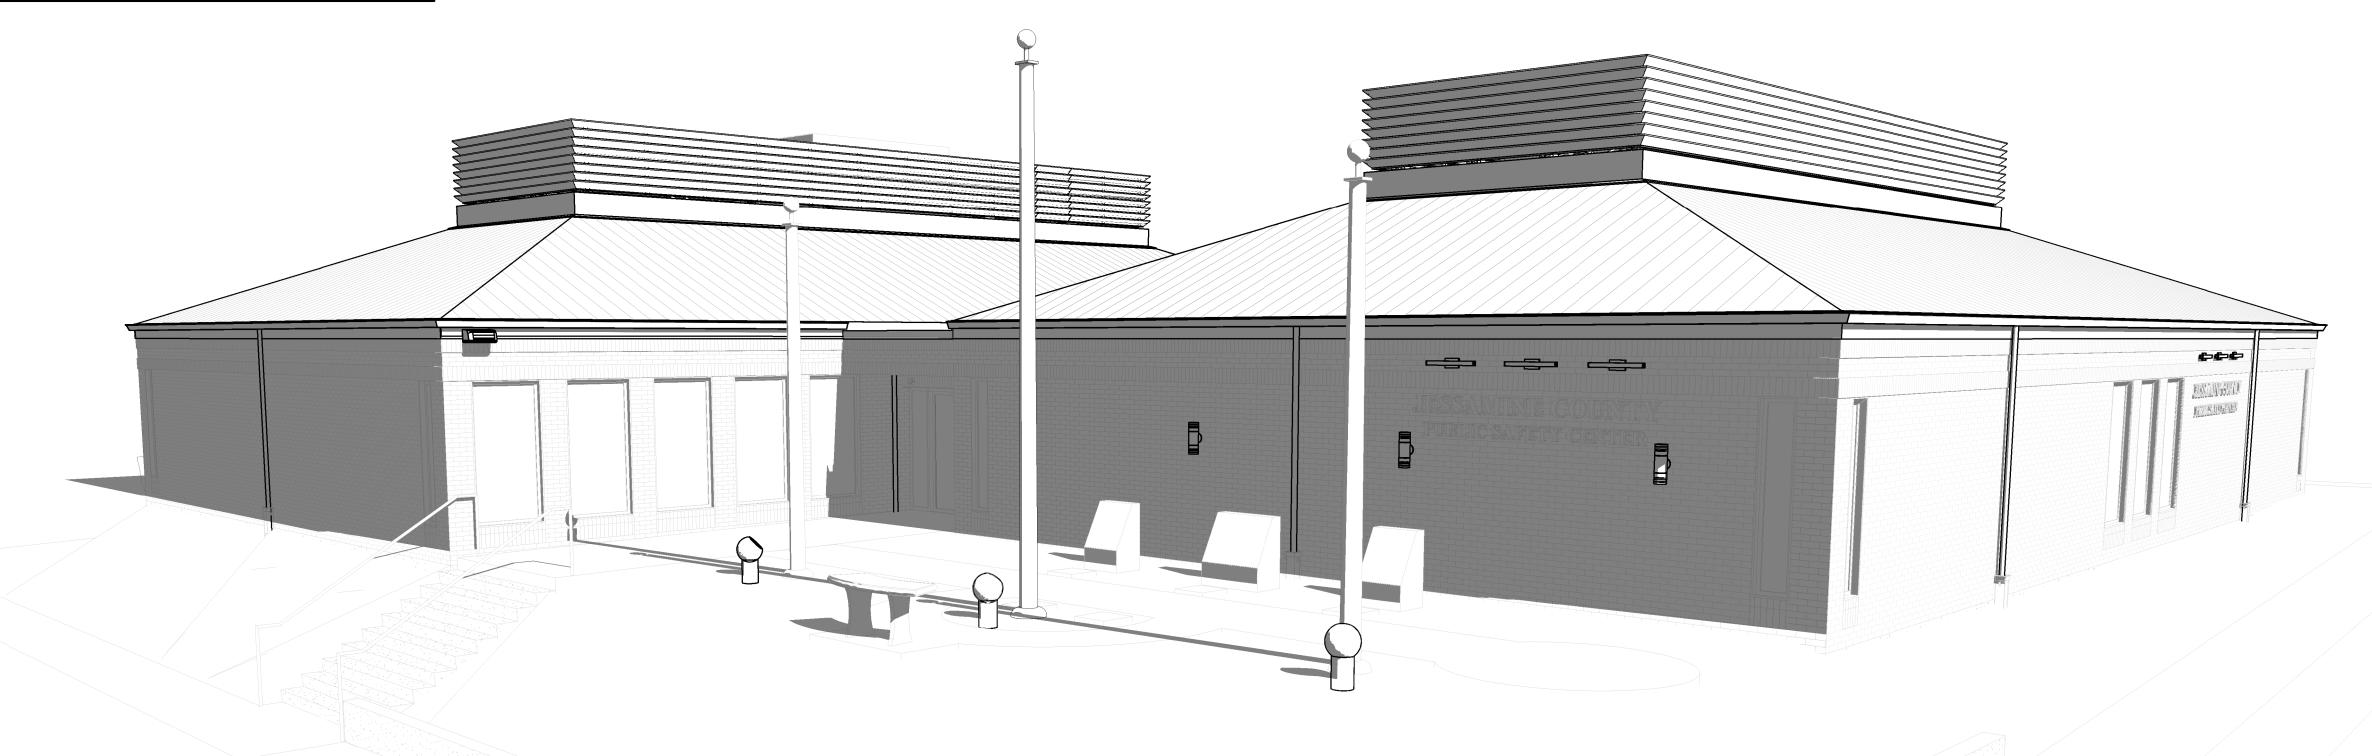



GRW PROJECT NO. 4571-04

ARCHITECTURAL MATERIAL INDICATIONS

CONCRETE MORTAR - CEMENT - GYPSUM CONCRETE MASONRY UNITS STEEL (CROSS SECTION) INSULATION (RIGID) INSULATION (BATT) WOOD (BLOCKING) WOOD (FINISH) PLYWOOD **RESIN PANEL** AGGREGATE BASE

(LARGE SCALE - SECTION)

ABBREVIATIONS

AIR CONDITIONED

ACOUST / P ACOUSTIC WALL PANEL

AREA DRAIN

ADDITIONAL

ALTERNATE

ALUMINUM

AMPERES

AIR HANDLING UNIT

APPROXIMATELY

ACCESS OPENING

ARCHITECTURAL

ASPHALT TILE

AUDIO VISUAL

BALANCE

BUILDING

BOARD

BLANK

BEAM

BOTTOM

BEARING

BOTTOM OF

CENTER LINE

CIRCUIT BREAKER

CEILING DIFFUSER

CUBIC FEET/MINUTE

CORRUGATED METAL DECKING

CONCRETE MASONRY UNIT

CABINET

CARPET

CEMENT

CERAMIC

CIRCUIT

CLOSET

CEILING

CLEAN OUT

CONCRETE

CONDENSATE

CONNECTION

CONTINUOUS

COORDINATE

CERAMIC TILE

DETAIL

DRAIN

DIAMETER

DIFFUSER

DIMENSION

DISCONNECT

DUMMY JOINT

DOWN SPOUT

DRAWING(S)

EMPTY CONDUIT

EXPANSION JOINT

ELECTRIC WATER COOLER

FLEXIBLE CONNECTION

FIRE EXTINGUISHER CABINET

FINISH FLOOR ELEVATION

EXHAUST FAN

ELECTRIC

ELEVATION

ENGINEER

EPOXY PAINT

EQUIPMENT

EXTERIOR

EXISTING

FIRE ALARM

FLOOR DRAIN

FACE OF

FINISH

FLOOR

FOOT, FEET

FIELD VERIFY

FOOTING

GALLON

GALVANIZED

GENERAL

GLASS

GLAZING

GROUND

GYPSUM

HOSE BIBB

HARDWARE

HEIGHT

HOUR

HEATER HEATING

HYDRANT

HOLLOW CORE

HOLLOW METAL

HORSE POWER

GALLONS/HOUR

GALLONS/MINUTE

GYPSUM WALL BOARD

HEATING AND VENTILATING

CONSTRUCTION

. CONTRACTION JOINT

CERAMIC TILE BASE

DEMOLISH / DEMOLITION

DRINKING FOUNTAIN

COLUMN

CIRCULATING

CONTROL JOINT

CAPACITY

ABUSE-RESISTANT GYP. BD.

BRITISH THERMO UNIT/HOUR

ACOUSTIC TILE CEILING

ACOUST / S ACOUSTIC TEXTURED SPRAY FINISH

AMERICANS WITH DISABILITIES ACT

AMERICAN NATIONAL STANDARDS INSTITUTE

I.D.

INSUL.

INT.

LAV.

L.P.

LB.,#

MAINT

MAX.

M.D.P.

MECH.

MIN.

MISC.

M.O.

M.T.

MTD.

MTG.

MTL.

M.V.

NO.

O.C.

OH.

OPP.

O.S.D.

PART.

PLBG.

P.O.T.

PRESS.

PRB

QTR.

QUAN.

RD.

RECP.

REG.

REQ.

RET.

RM.

R.P.M.

SECT.

SERV.

STRUCT.

TEMP.

TYP.

URIN.

UTIL.

VCT

VENT.

VERT.

W.C.

WF

W.W.F.

THRESH.

N.A., N/A

MRGB

INSIDE DIAMETER

INCANDESCENT

INTERNATIONAL

JUNCTION BOX

INSULATION

INTERIOR

JANITOR

JOINT

LONG

LAVATORY

LIGHTING

MAXIMUM

MINIMUM

MOUNTED

MOUNTING

METAL

NUMBER

ON CENTER

OVERHEAD

OPENING

OPPOSITE

PARTITION

PLUMBING PLYWOOD PANEL

PLATE

PERIMETER

MECHANICAL

MISCELLANEOUS

MATT GLAZE TILE

NOT APPLICABLE

NOT IN CONTRACT

OUTSIDE DIAMETER

OPEN SIGHT DRAIN

POINT OF INTERSECTION

POINT ON TANGENT

PROFILED RUBBER BASE

POUNDS/SQUARE FOOT

POUNDS/SQUARE INCH

PRE-ENGINEERED WOOD

PREFINISHED

QUARRY TILE

QUARTER

QUANTITY

RISER

RADIUS

ROUND

RETURN AIR

RUBBER COVE BASE

REVOLUTION/MINUTE

RECOMMENDED

RECIRCULATING

RECEPTACLE

REINFORCING

REGISTER

REQUIRED

RETURN RETURN GRILLE

SUPPLY

SECTION

SERVICE

SLIP JOINT

STORAGE

STRUCTURAL

SUSPENDED

SHEET VINYL

TELEPHONE

THRESHOLD

TOP OF

TYPICAL

URINAL

UTILITY

VENTILATION

WIDE FLANGE

VERTICAL

WITH

TEMPERATURE

SQ. FT., SF SQUARE FEET

SPECIFICATIONS

SCHEDULE

QUARRY TILE BASE

PRESSURE

MASONRY OPENING

METAL THRESHOLD

LIGHTING PANEL

MOISTURE-RESISTANT GYP.BD. MAINTENANCE

MAIN DISTRIBUTION PANEL

MECHANICAL VENTILATION

POUND

JUNCTION

INCHES

A.C.

ADA

ADDIT.

A.H.U.

ALUM.

ANSI

A.O.

ARCH.

ARGB

A.T.

BAL.

BD.

BLDG

BLK.

BOT.

B.O.

CAB.

CAP.

C/B

C.D.

CEM.

CER

C.F.M.

CIRC.

C.J.

CKT.

CLG.

CMD

C.O.

COL.

CONC.

COND.

CONN.

CONT.

CONTR. JT.

COORD.

CT

CTB

DEMO

DET.

DIA.

DIFF.

DISC.

D.J. DN.

D.S.

E.C.

E.F.

E.J.

ELEC.

ELEV.

ENG.

EQUIP.

E.W.C.

EXH.

EXT.

F.A.

F.C.

F.D.

F.E.C.

F.F.E.

F.O.

FIN.

FLR.

FTG.

F.V.

GA.

GAL.

GALV.

GEN.

GL.

GLAZ.

G.P.H.

G.P.M.

G.W.B.

GYP.

H.&V.

H.B.

H.C.

HDWR.

HGHT.

H.M.

H.P.

HR.

HTR.

HYD.

FT.

EXIST.

EP

DWG.(S)

CONST.

C.M.U.

CARPT

B.T.U.H.

BM.

 AV


AMP., A.

APPROX.

ALT

ACOUST

ARCHITECTURAL SYMBOL KEY:

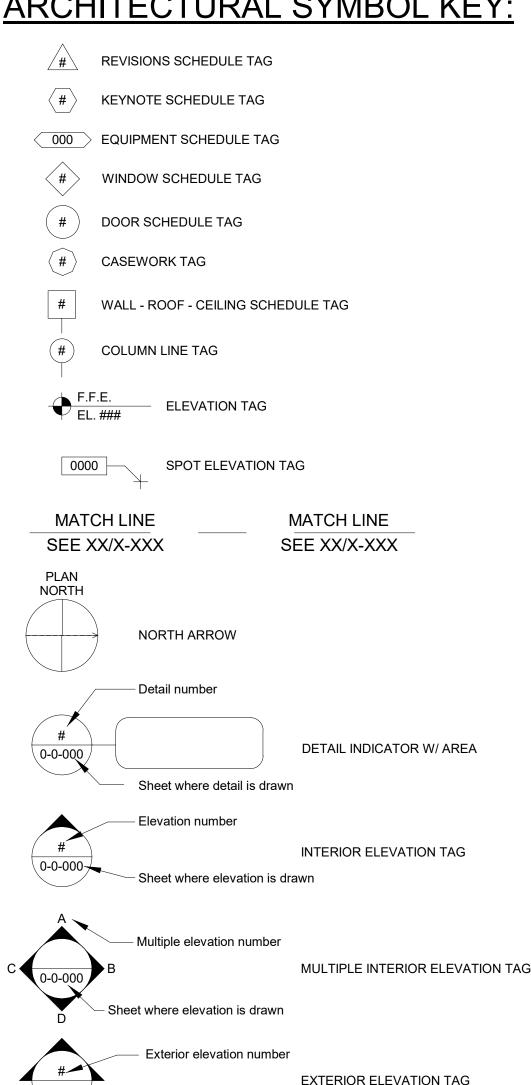

Sheet where elevation is drawn


SECTION CUT TAG

Section cut number

Sheet where section is drawn

GENERAL ARCHITECTURAL NOTES:

- 1. DIMENSIONS THAT ARE NOT STATED AS "MAXIMUM" OR "MINIMUM" ARE ABSOLUTE.
- 2. CONTRACTOR SHALL NOT SCALE DRAWINGS FOR DIMENSIONAL USE. USE ONLY WRITTEN DIMENSIONS.
- 3. ALL EQUIPMENT SHOWN IN THE DRAWINGS IS TO BE CONTRACTOR FURNISHED AND INSTALLED UNLESS NOTED "NIC".
- 4. CONTRACTOR AND SUB-CONTRACTORS TO VERIFY ALL DIMENSIONS IN THE FIELD PRIOR TO BEGINNING CONSTRUCTION OR ORDERING MATERIALS. INQUIRIES AND DISCREPANCIES SHOULD BE DIRECTED TO THE ARCHITECT.
- 5. ALL ROOM NUMBERS ARE FOR CONSTRUCTION PURPOSES ONLY.
- 6. PROPERLY SEAL ALL CONDUITS, PIPES, DUCTS & OTHER ITEMS OR SYSTEMS THAT PENETRATE FIRE-RATED PARTITIONS, WALLS, AND FLOORS. PROVIDE CLASSIFIED SEALANT SYSTEMS BY UNDERWRITERS LABORATORIES, INC.
- 7. THE CONTRACTOR SHALL COORDINATE SIZE AND LOCATION OF HVAC, PLUMBING, ELECTRICAL, AND TECHNOLOGY ITEMS OR OPENINGS PRIOR TO PROCEEDING WITH RELATED WORK.
- PROVIDE ACCESS PANELS AS REQUIRED BY APPLICABLE CODES AND AS REQUIRED FOR MECHANICAL EQUIPMENT. ACCESS PANELS LOCATED IN FINISH AREAS SHALL BE PAINTED OR PREFINISHED TO MATCH ADJACENT SURFACES. SEE SPECIFICATIONS FOR REQ'S.
- 9. UNLESS SHOWN OTHERWISE, DOOR LOCATIONS NOT LOCATED BY DIMENSIONS SHALL BE CENTERED IN WALL OR BE LOCATED FOUR INCHES (4") FROM FINISHED PERPENDICULAR WALL TO OUTSIDE EDGE OF DOOR FRAME. SEE PLANS.
- 10. DETAILS NOT SHOWN ARE SIMILAR IN CHARACTER TO THOSE SHOWN. WHERE SPECIFIC DIMENSIONS, DETAILS, OR DESIGN INTENT CANNOT BE DETERMINED, CONSULT THE ARCHITECT PRIOR TO PROCEEDING WITH
- 11. SEPARATE ALL DISSIMILAR METALS TO PREVENT CORROSION CAUSE BY ELECTROLYSIS ACTION OR OTHER CAUSES AS RECOMMENDED BY THE RESPECTIVE PRODUCT MANUFACTURER OR SUPPLIER.
- 12. ALL ELEMENTS ARE TO BE INSTALLED PER ADOPTED KY BUILDING, PLUMBING, MECHANICAL AND ENERGY CODES. ALL CONCERNS / DEVIATIONS ARE TO BE BROUGHT TO THE ARCHITECT FOR REVIEW AND RESOLUTION.




NOTE ARCHITECTURAL GISSAMINE CO. EMEFERTOR RELIGIOR R


 ∞


JULY 14, 2023


AE001


VINYL COMPOSITION TILE WATER CLOSET WELDED WIRE FABRIC

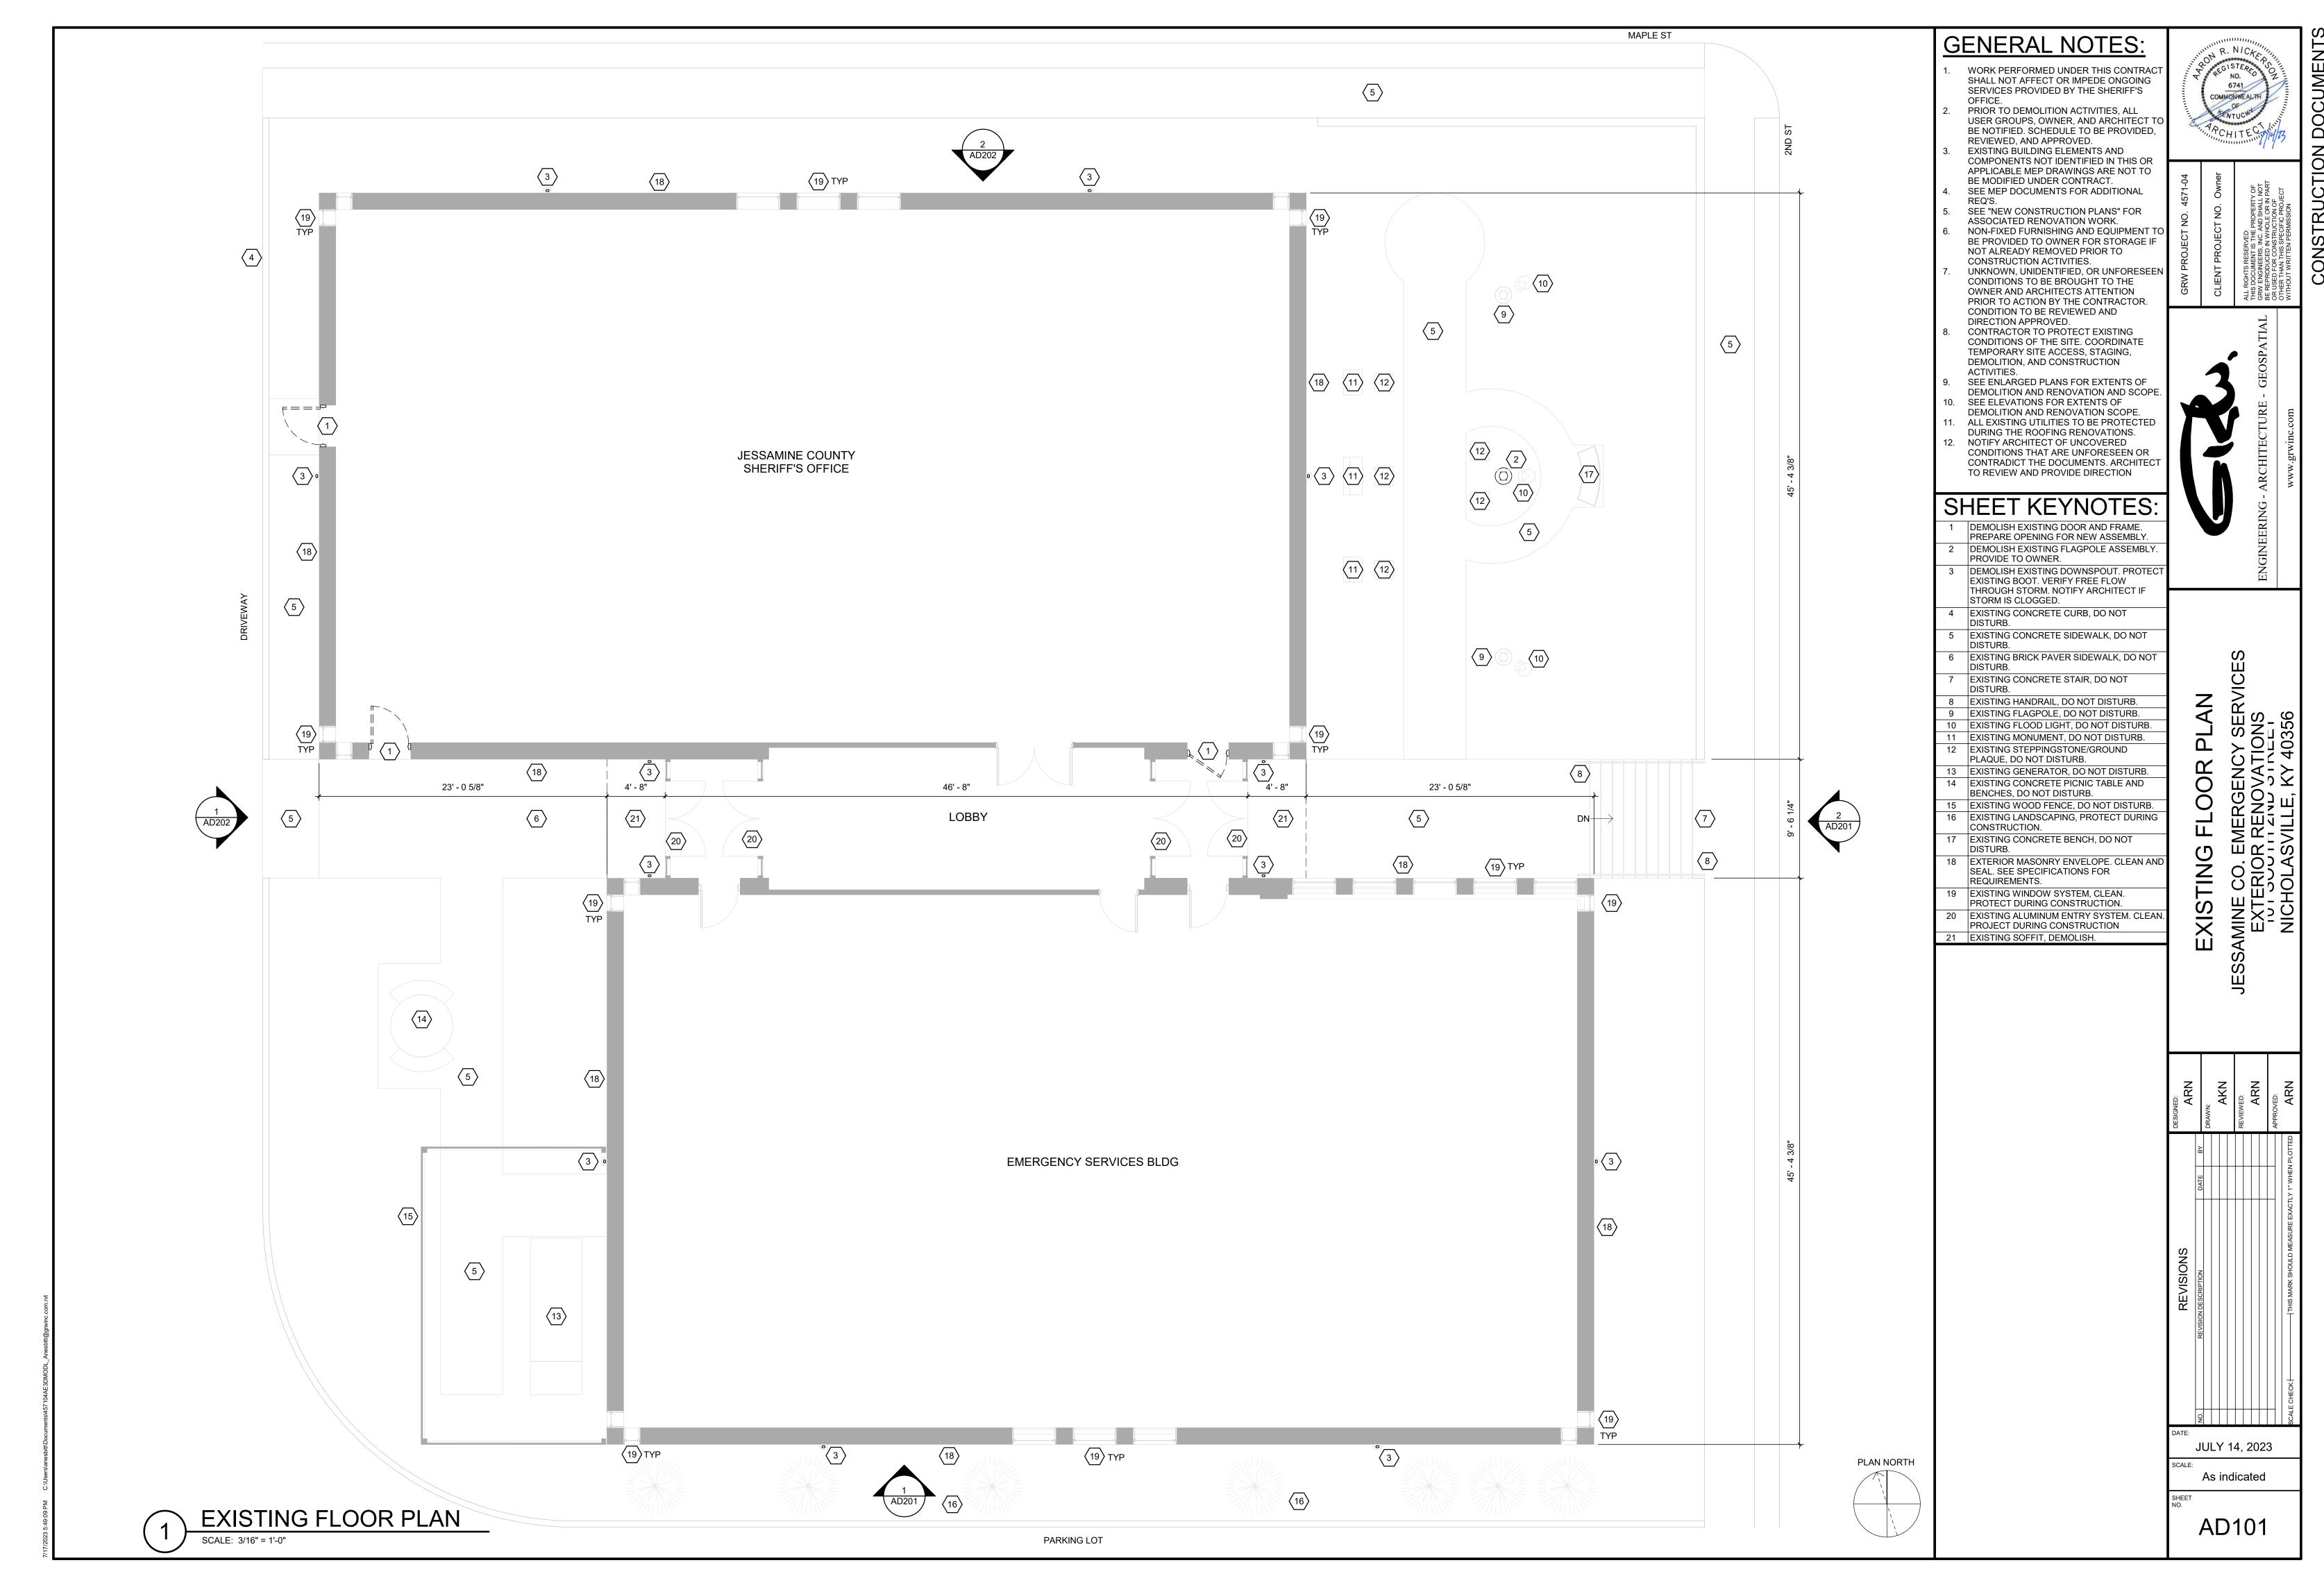


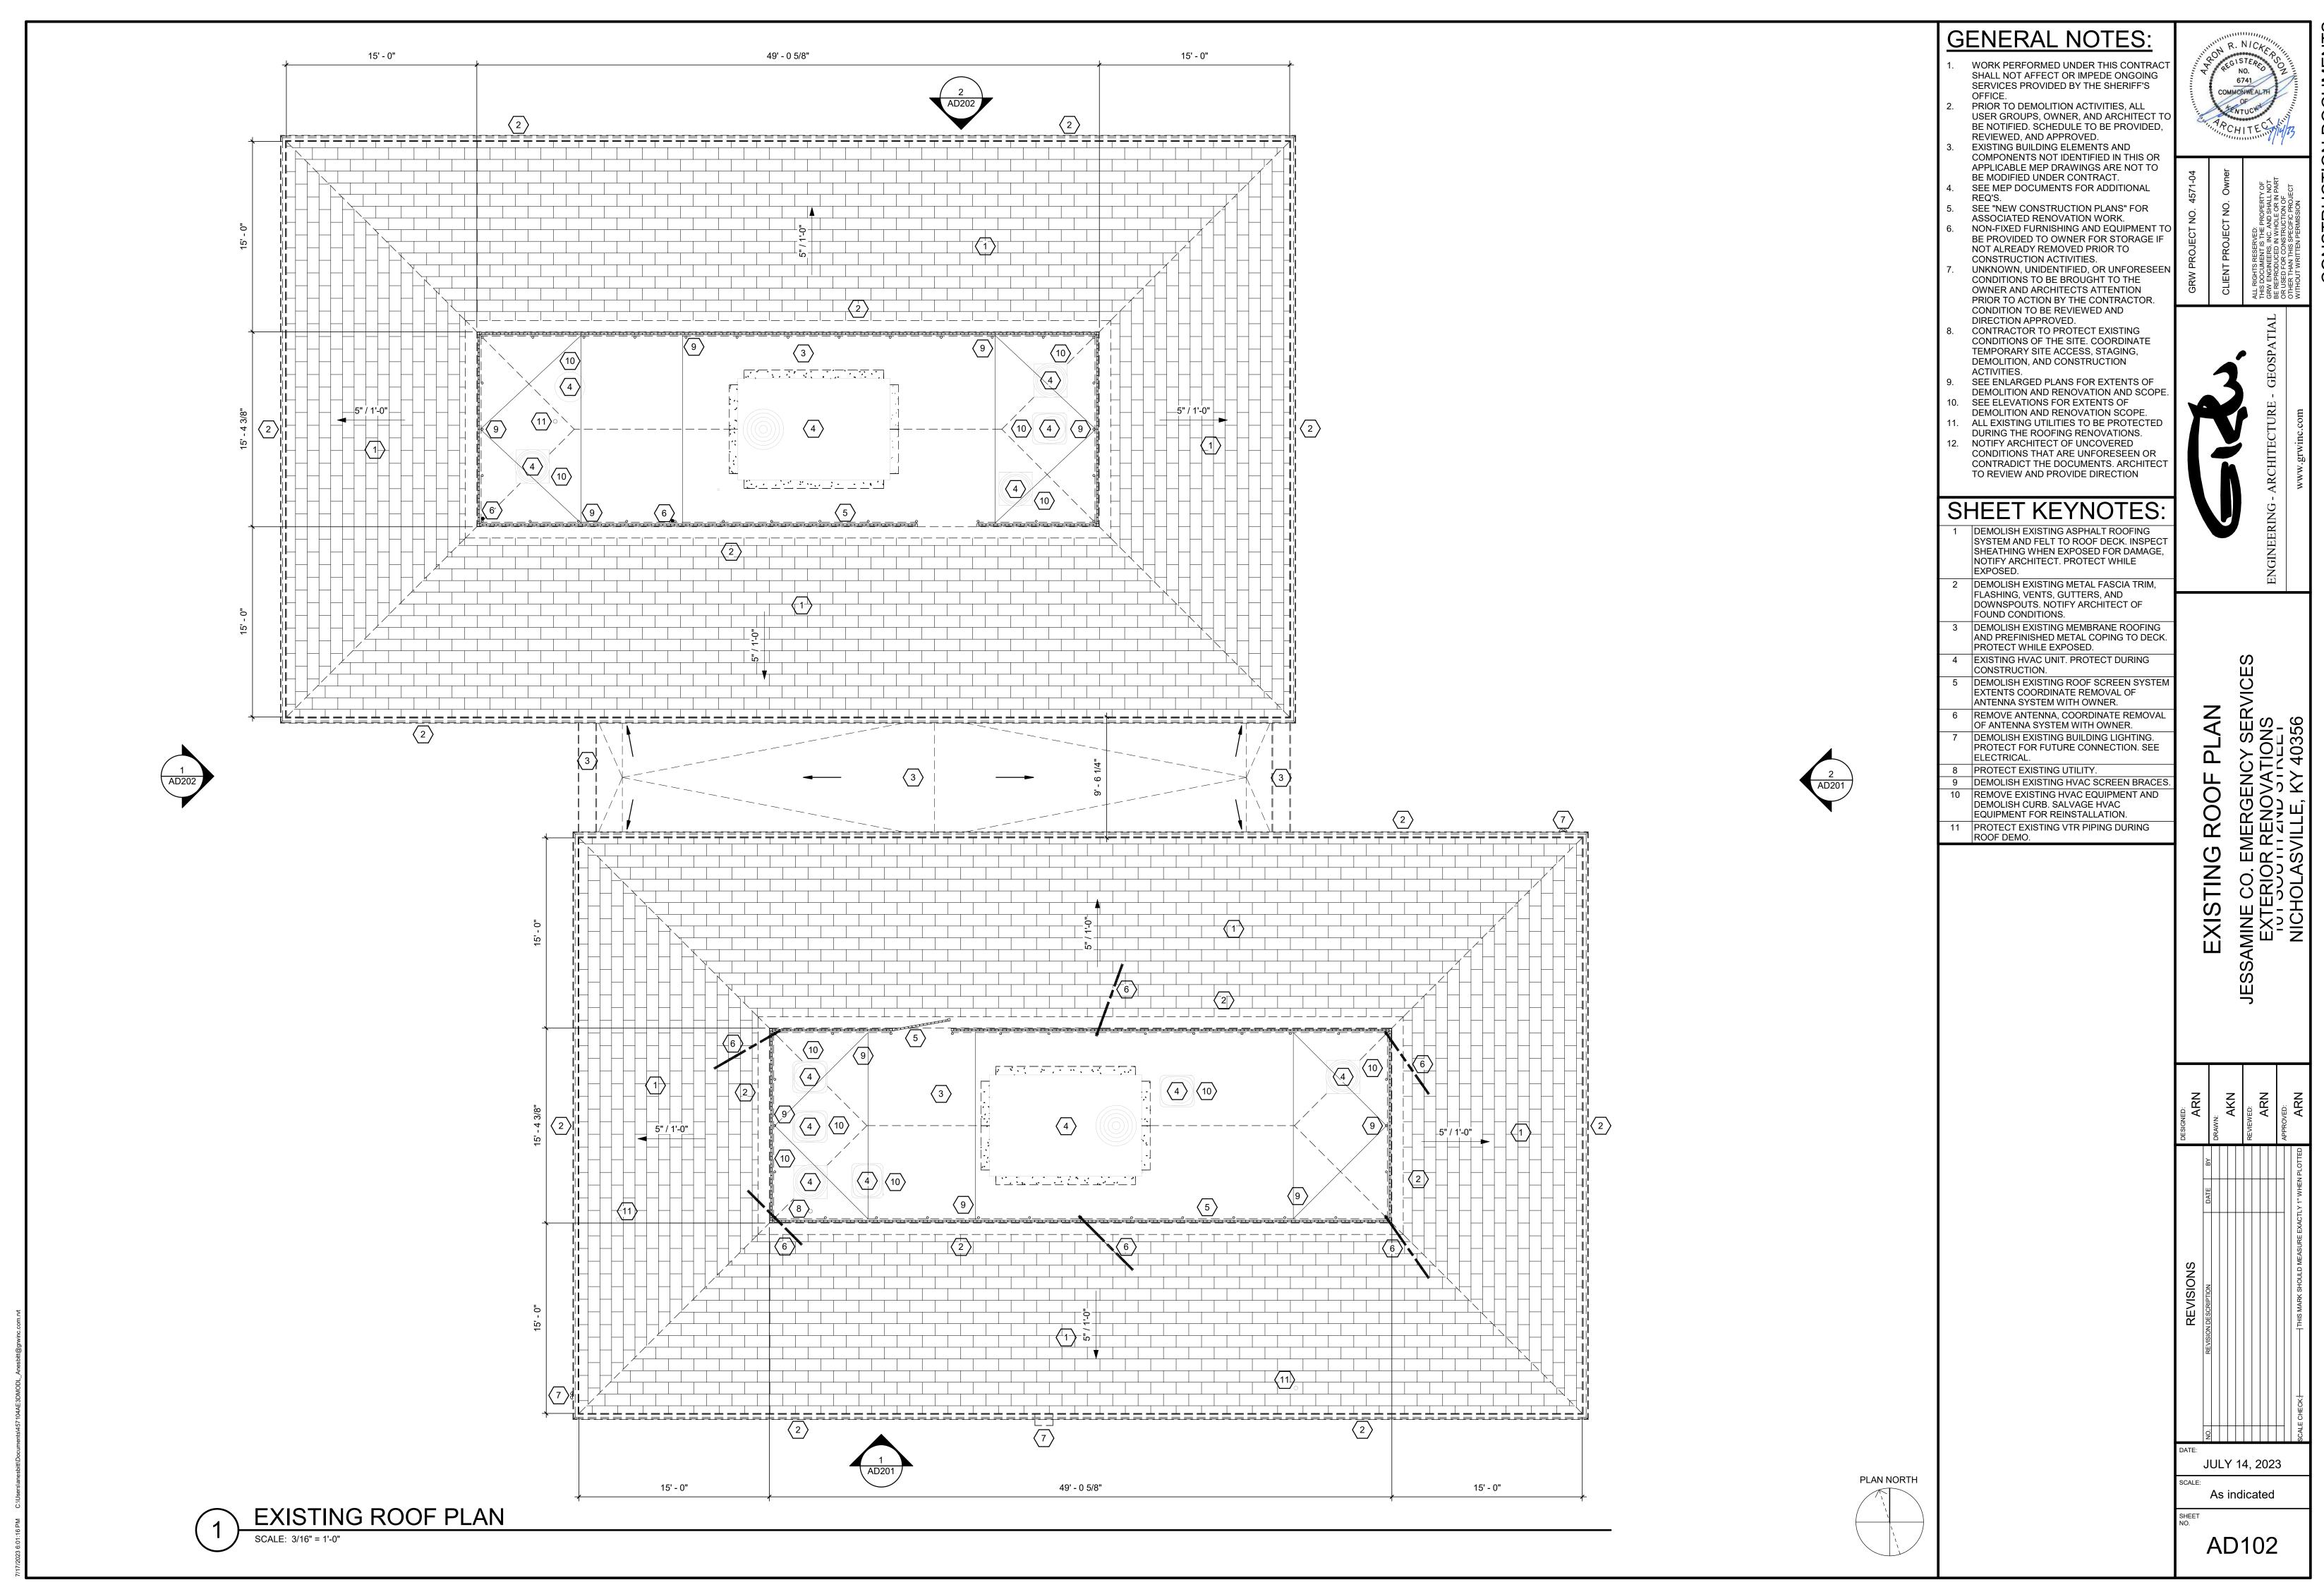


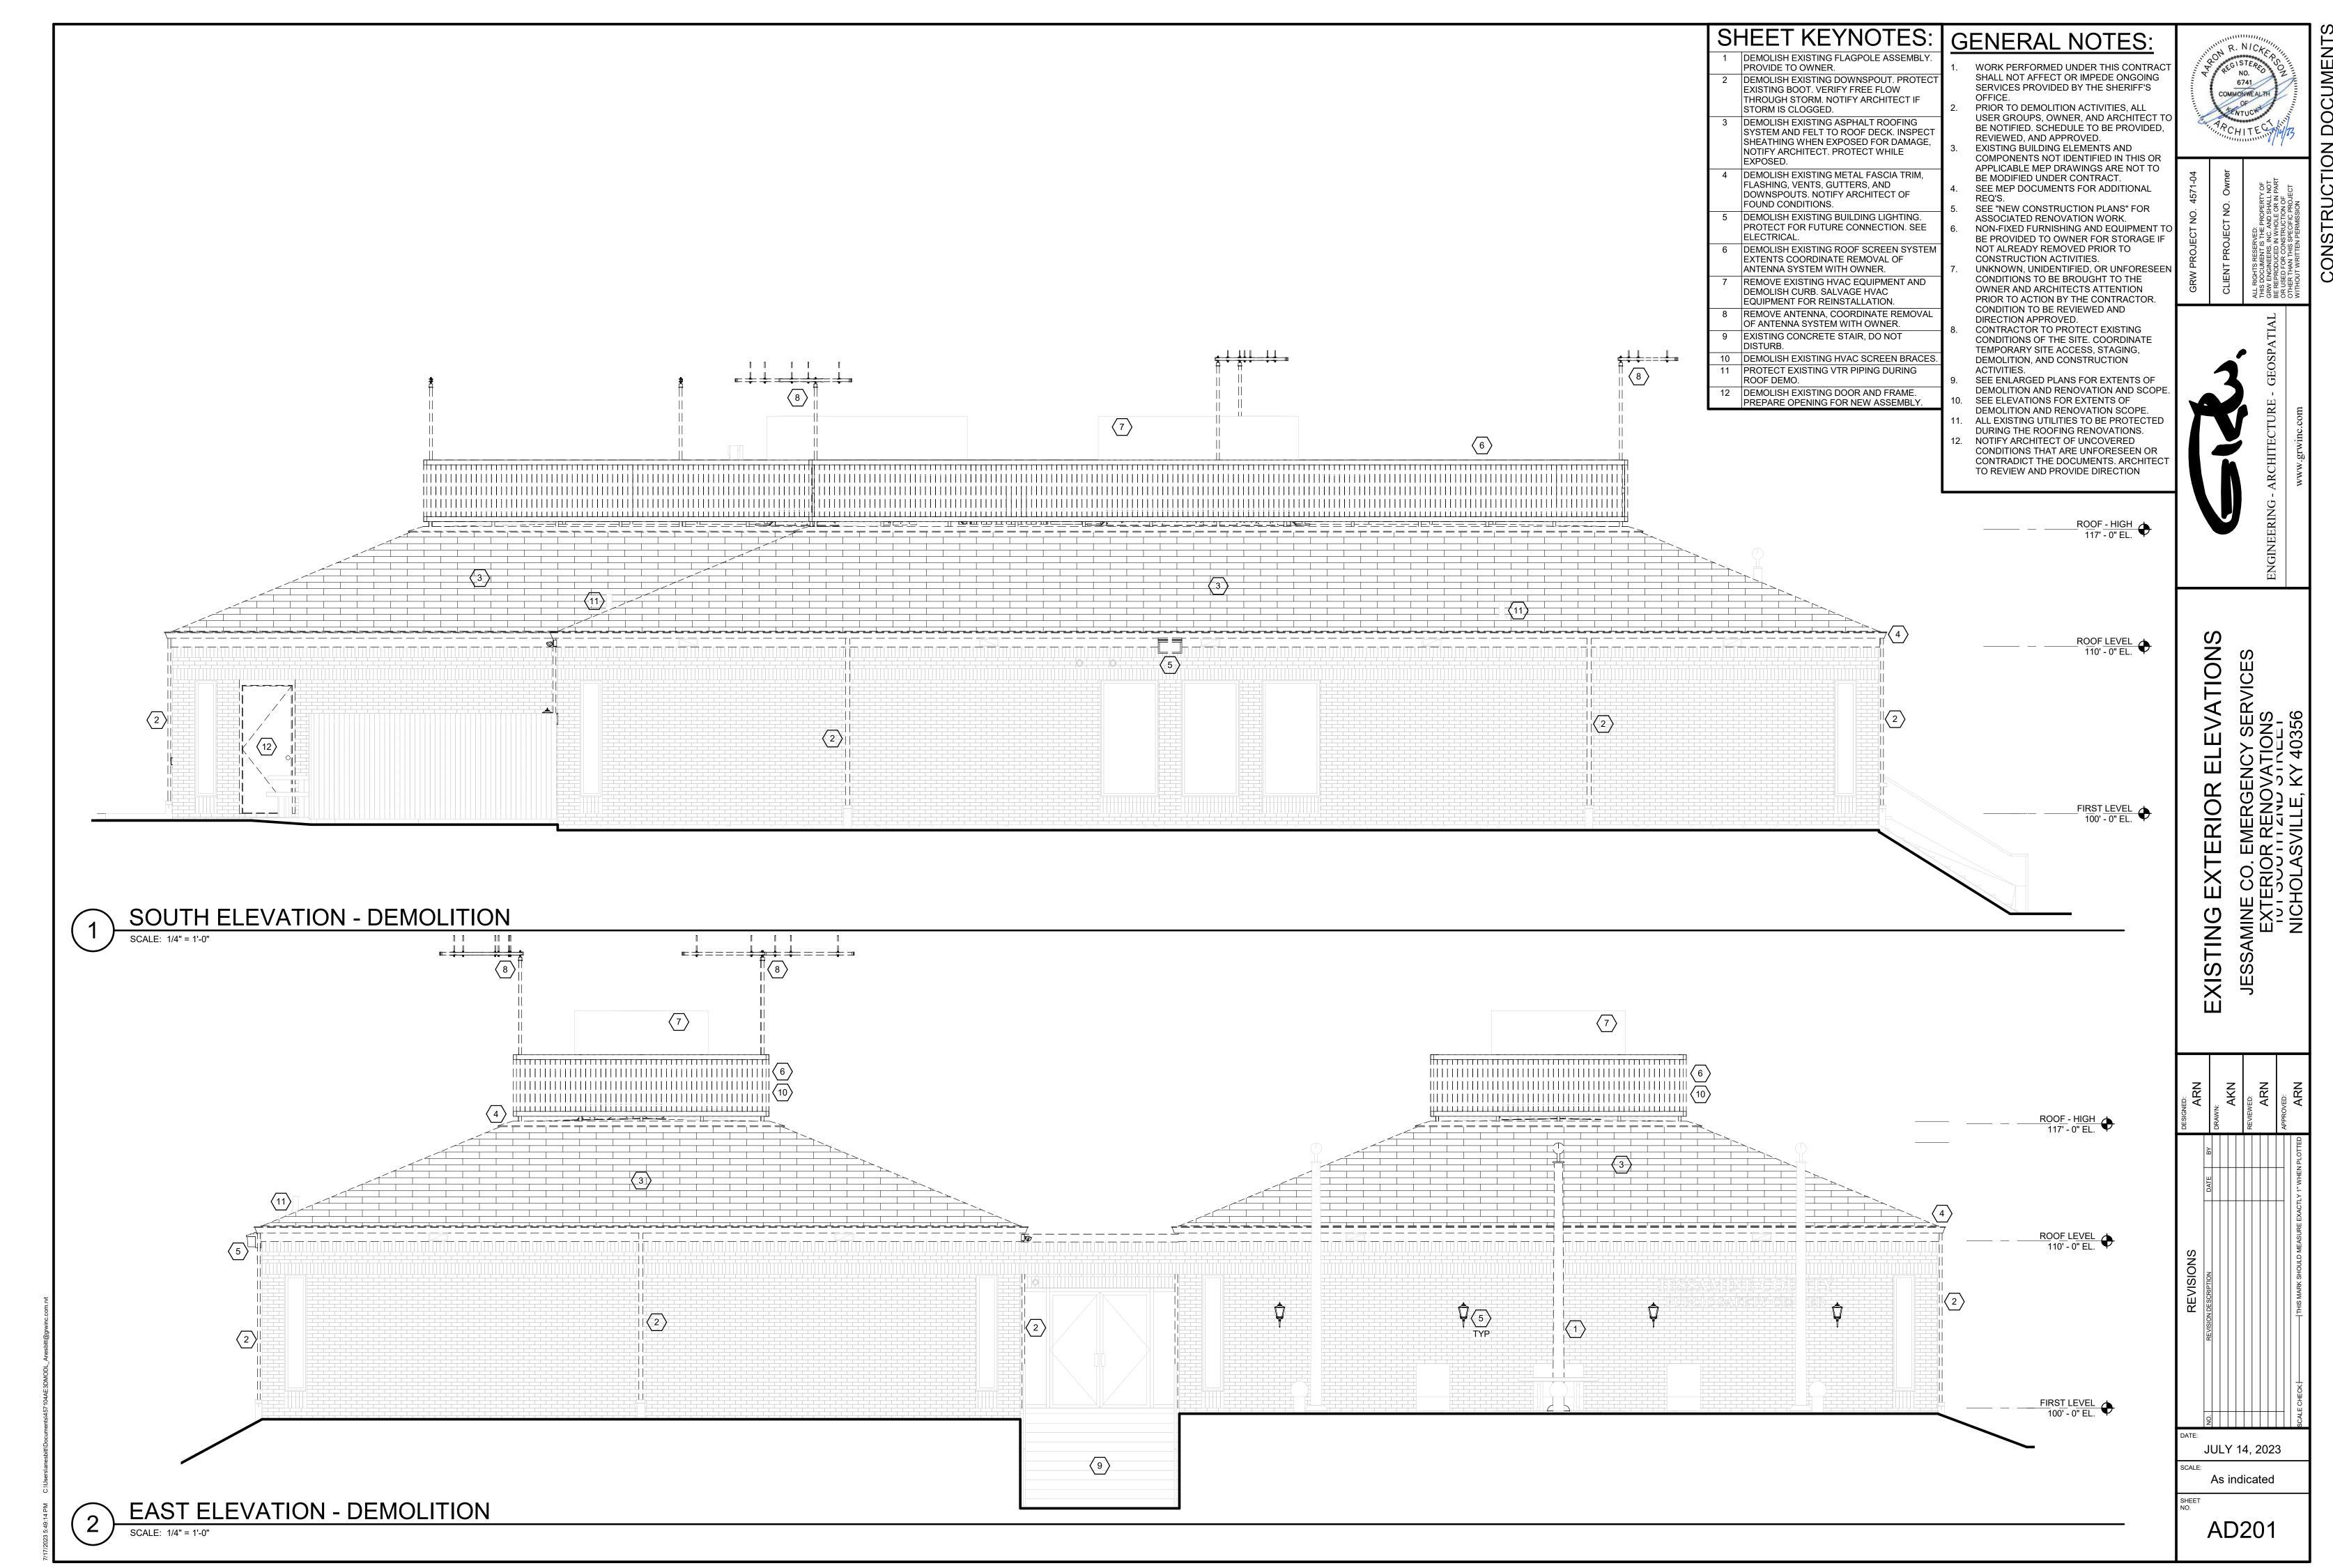


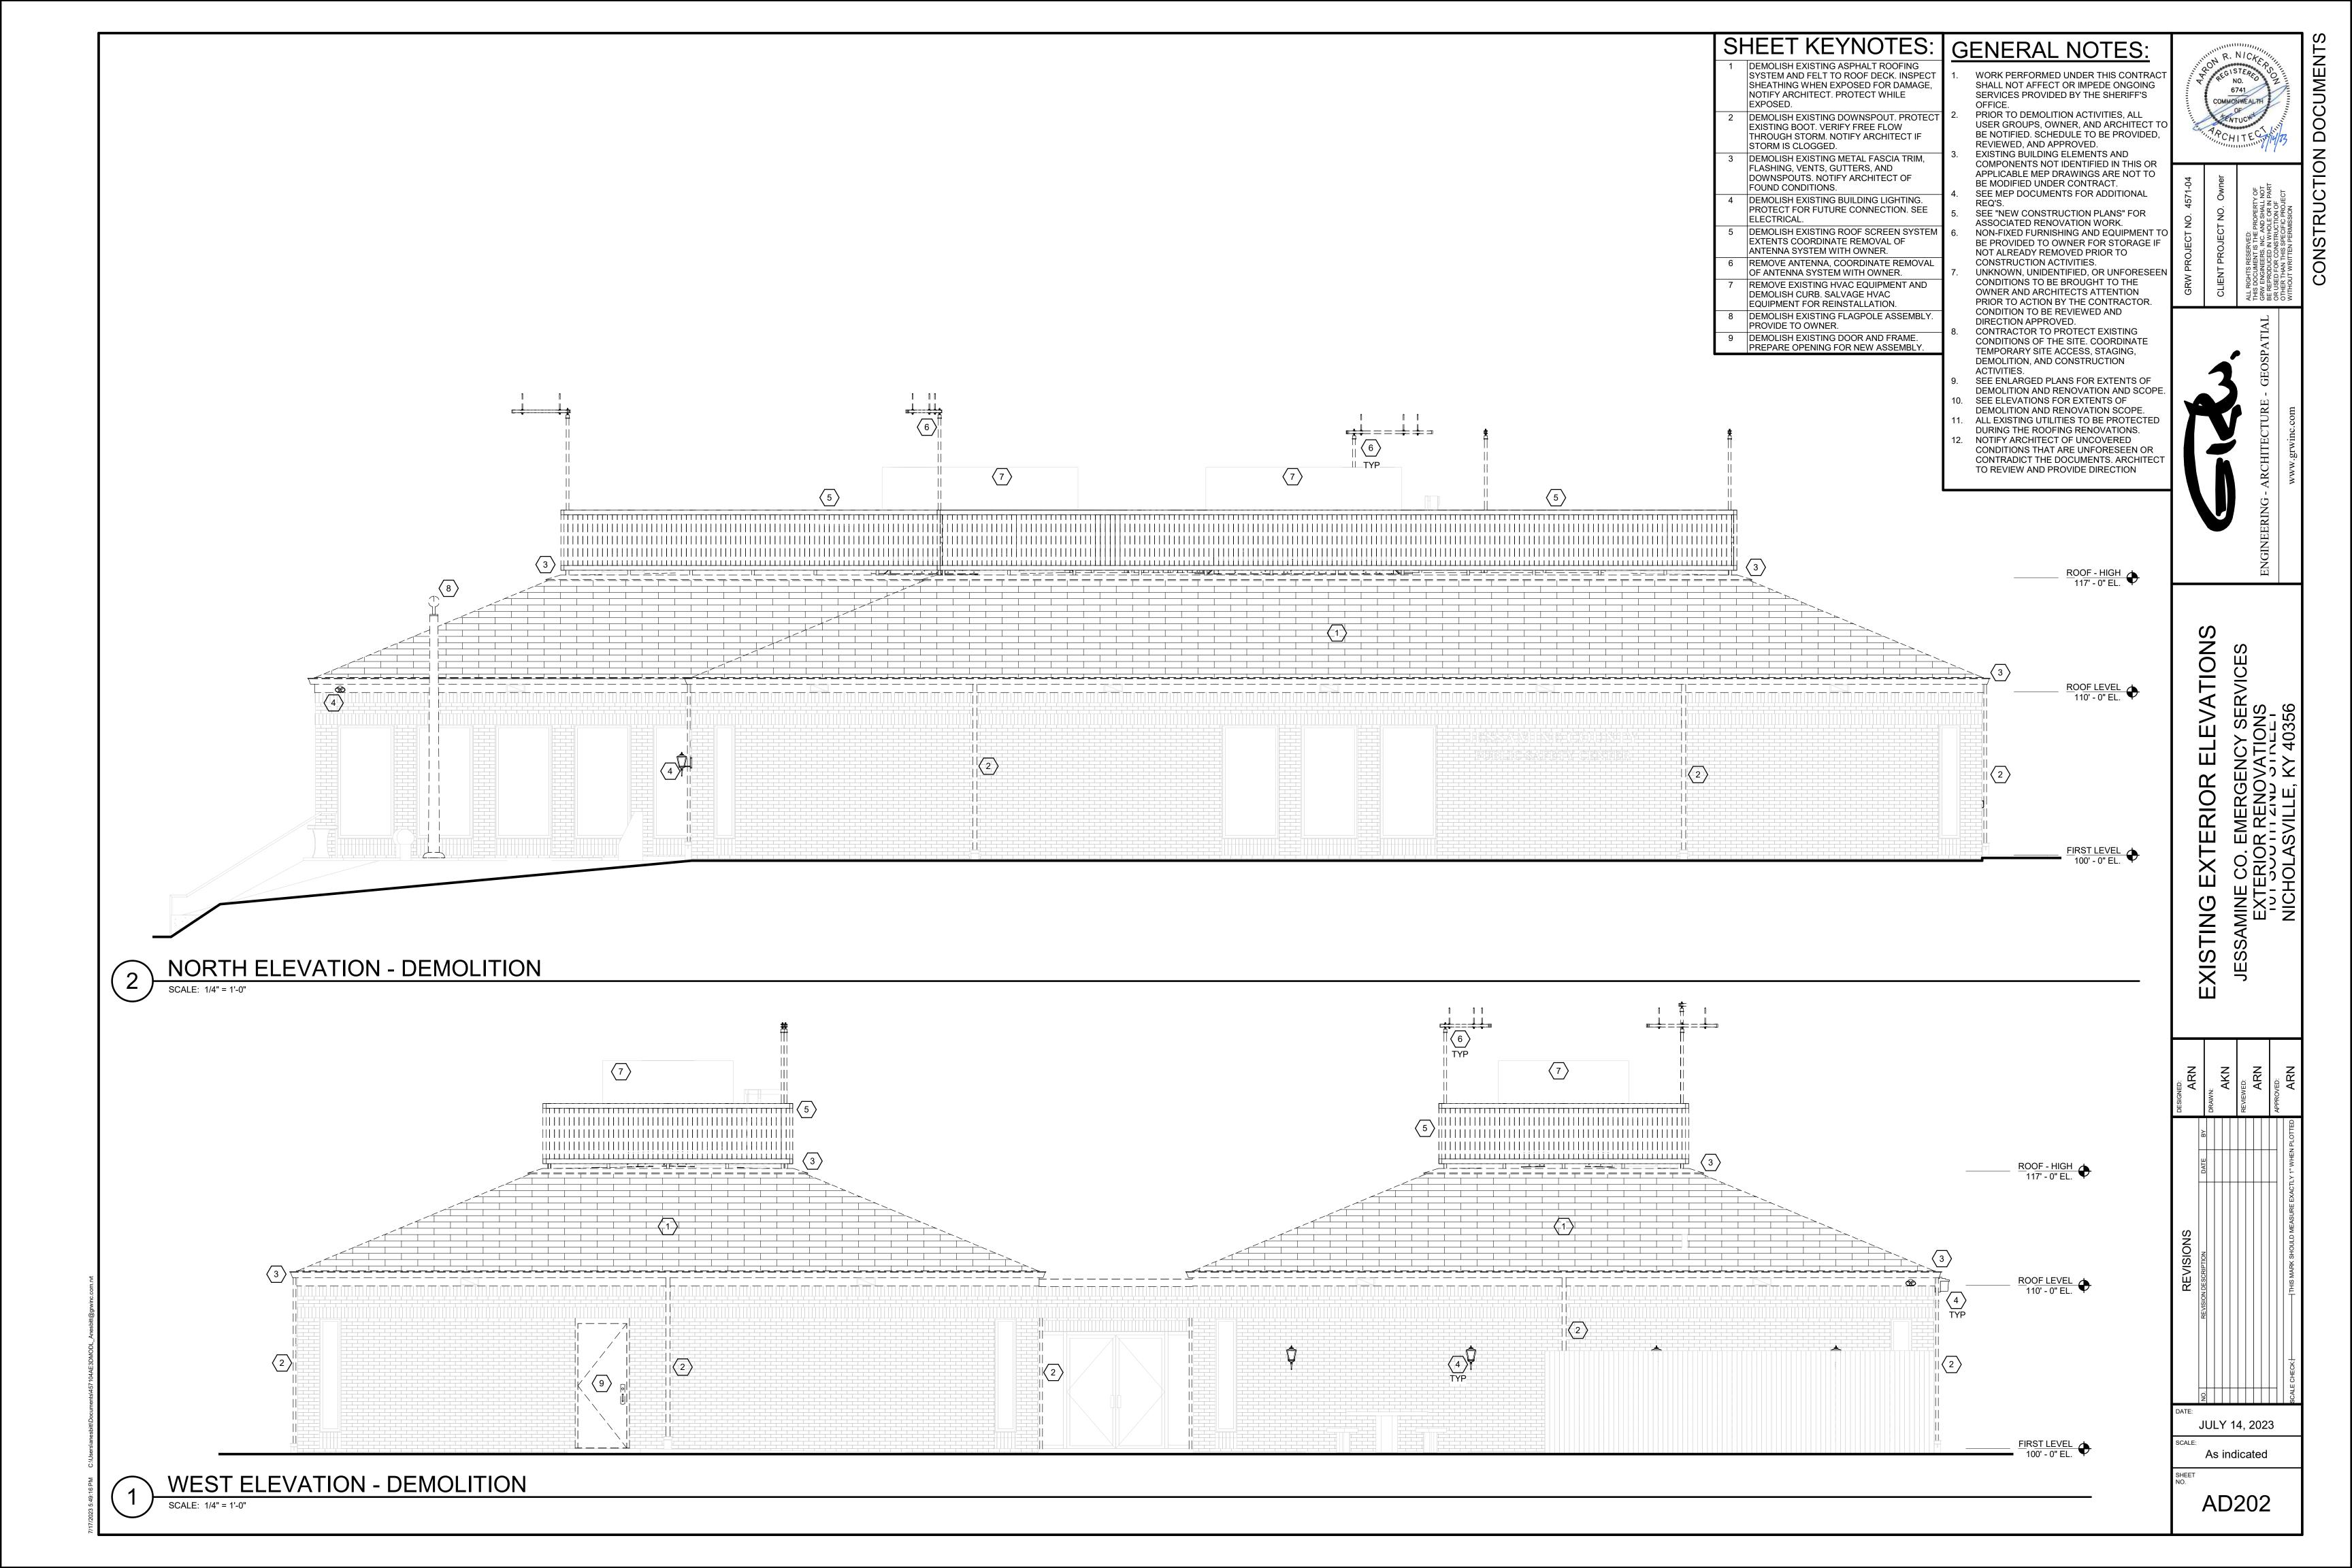


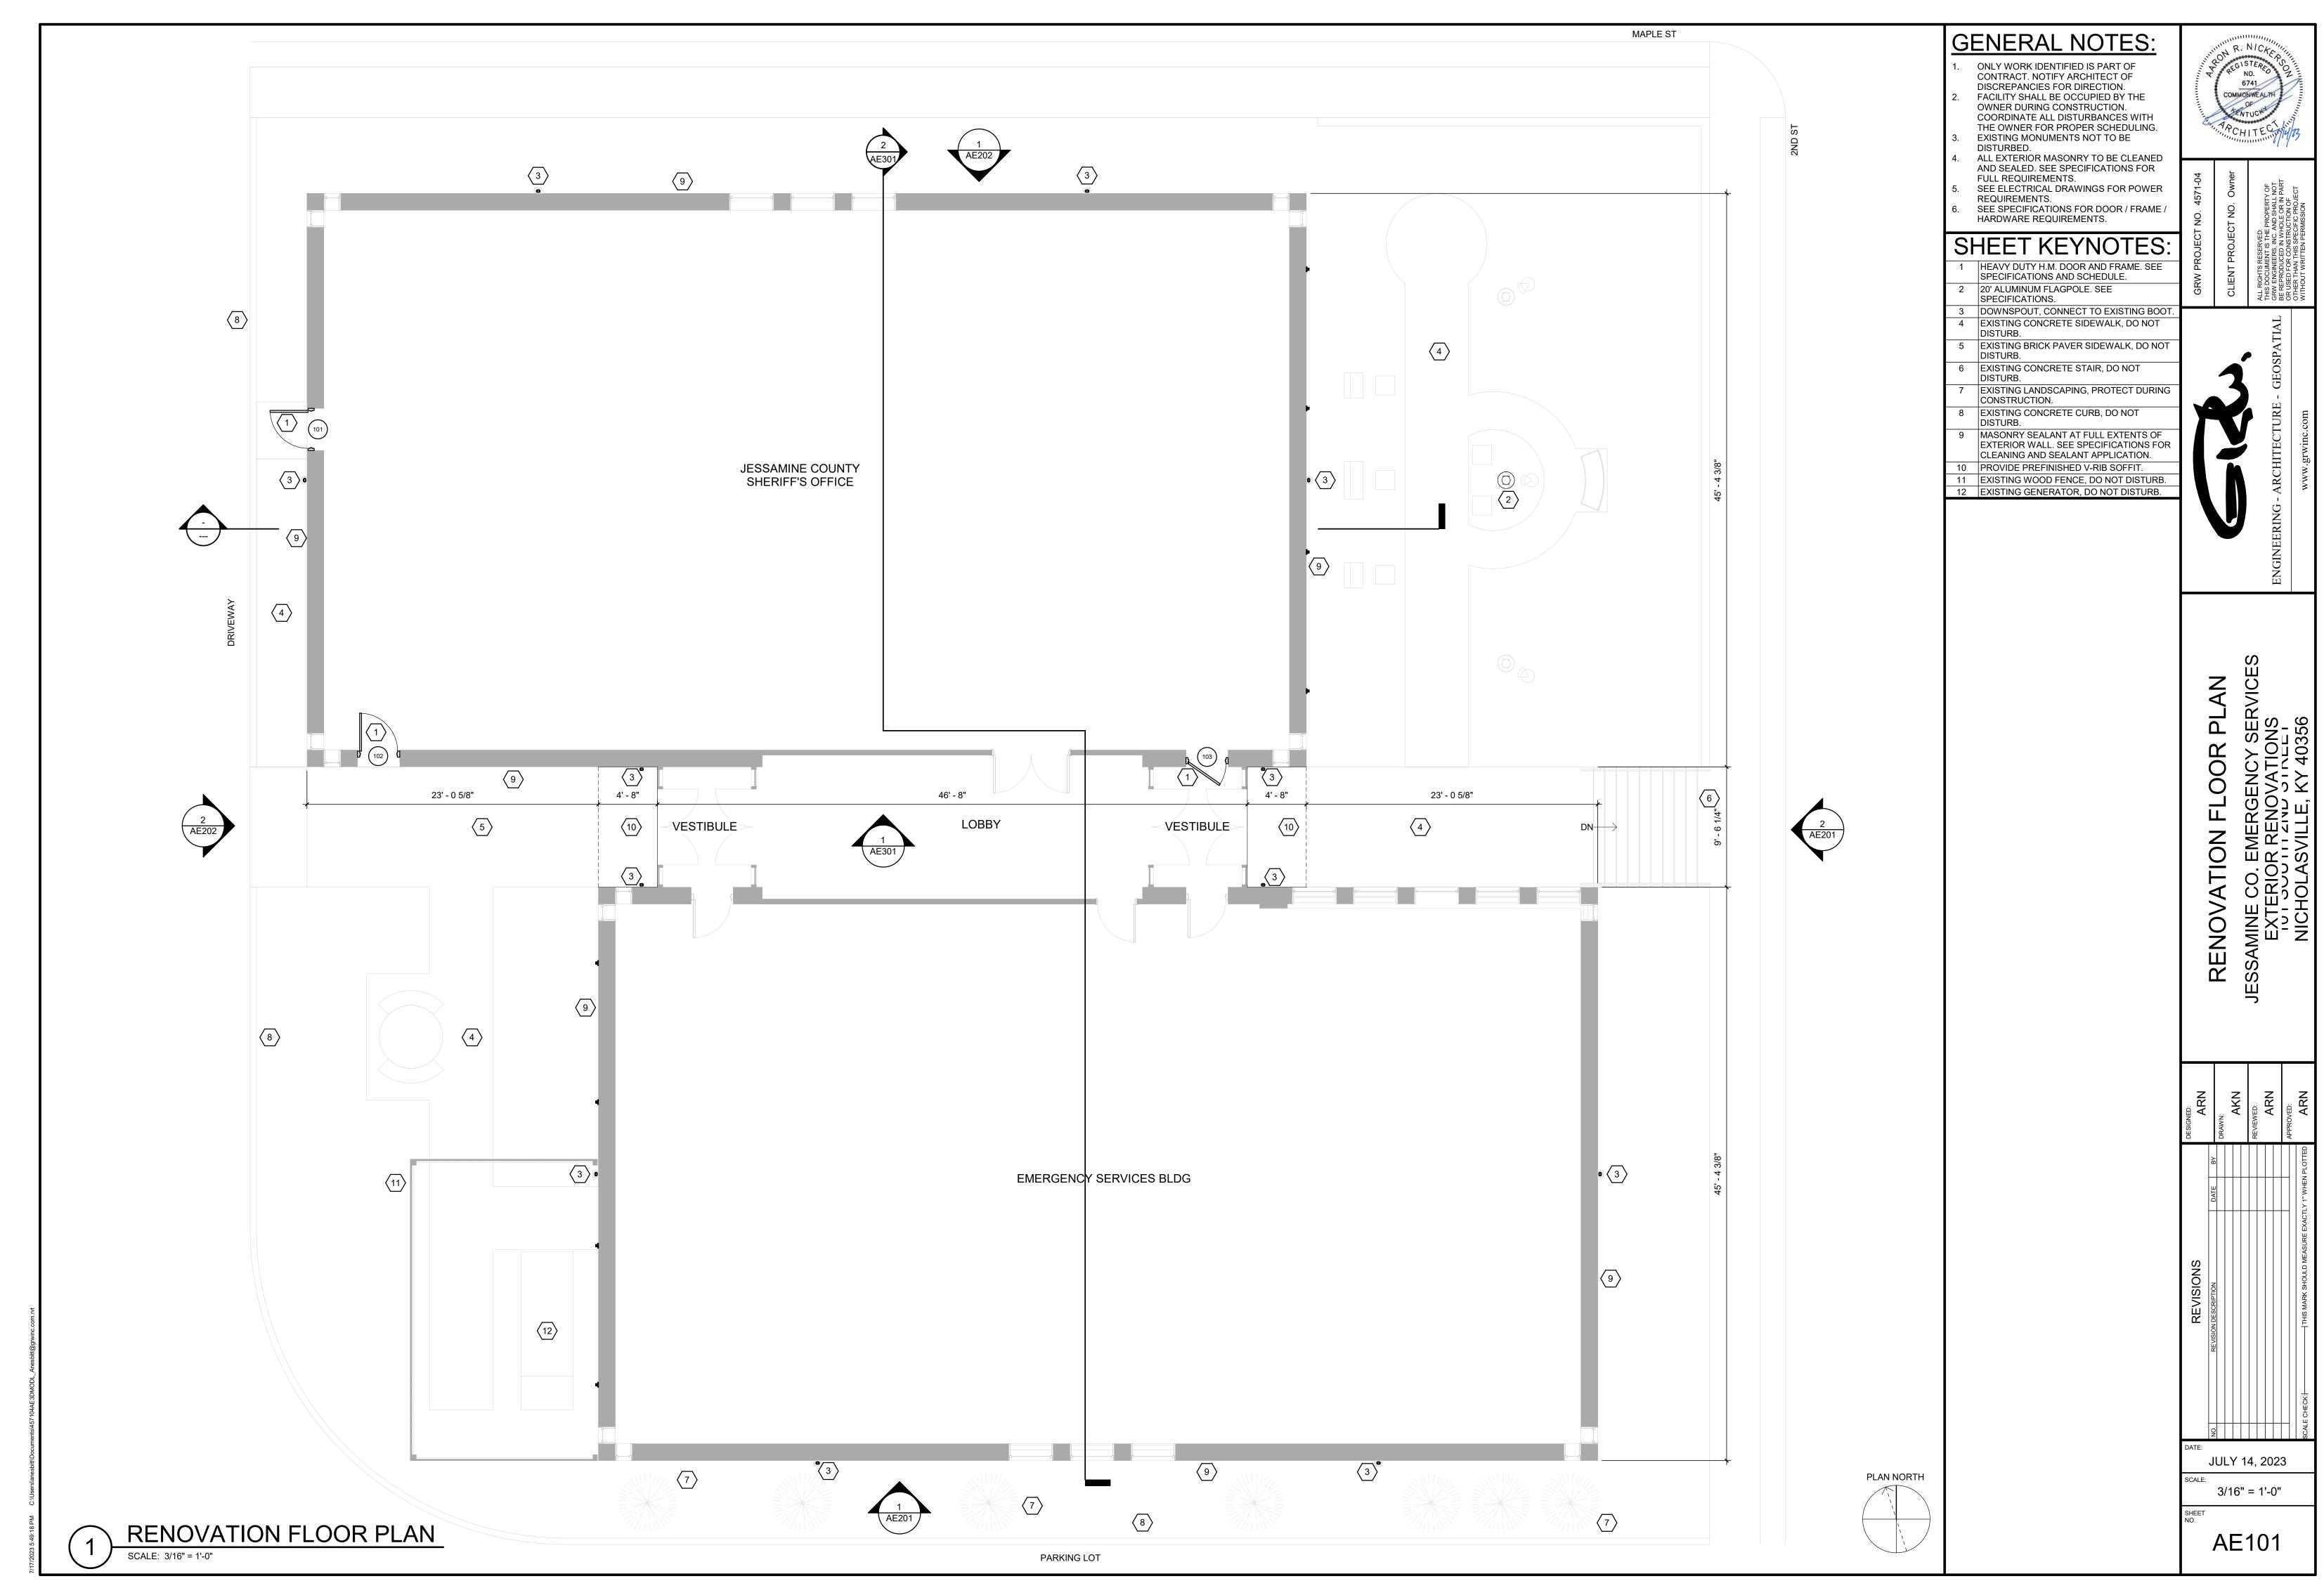

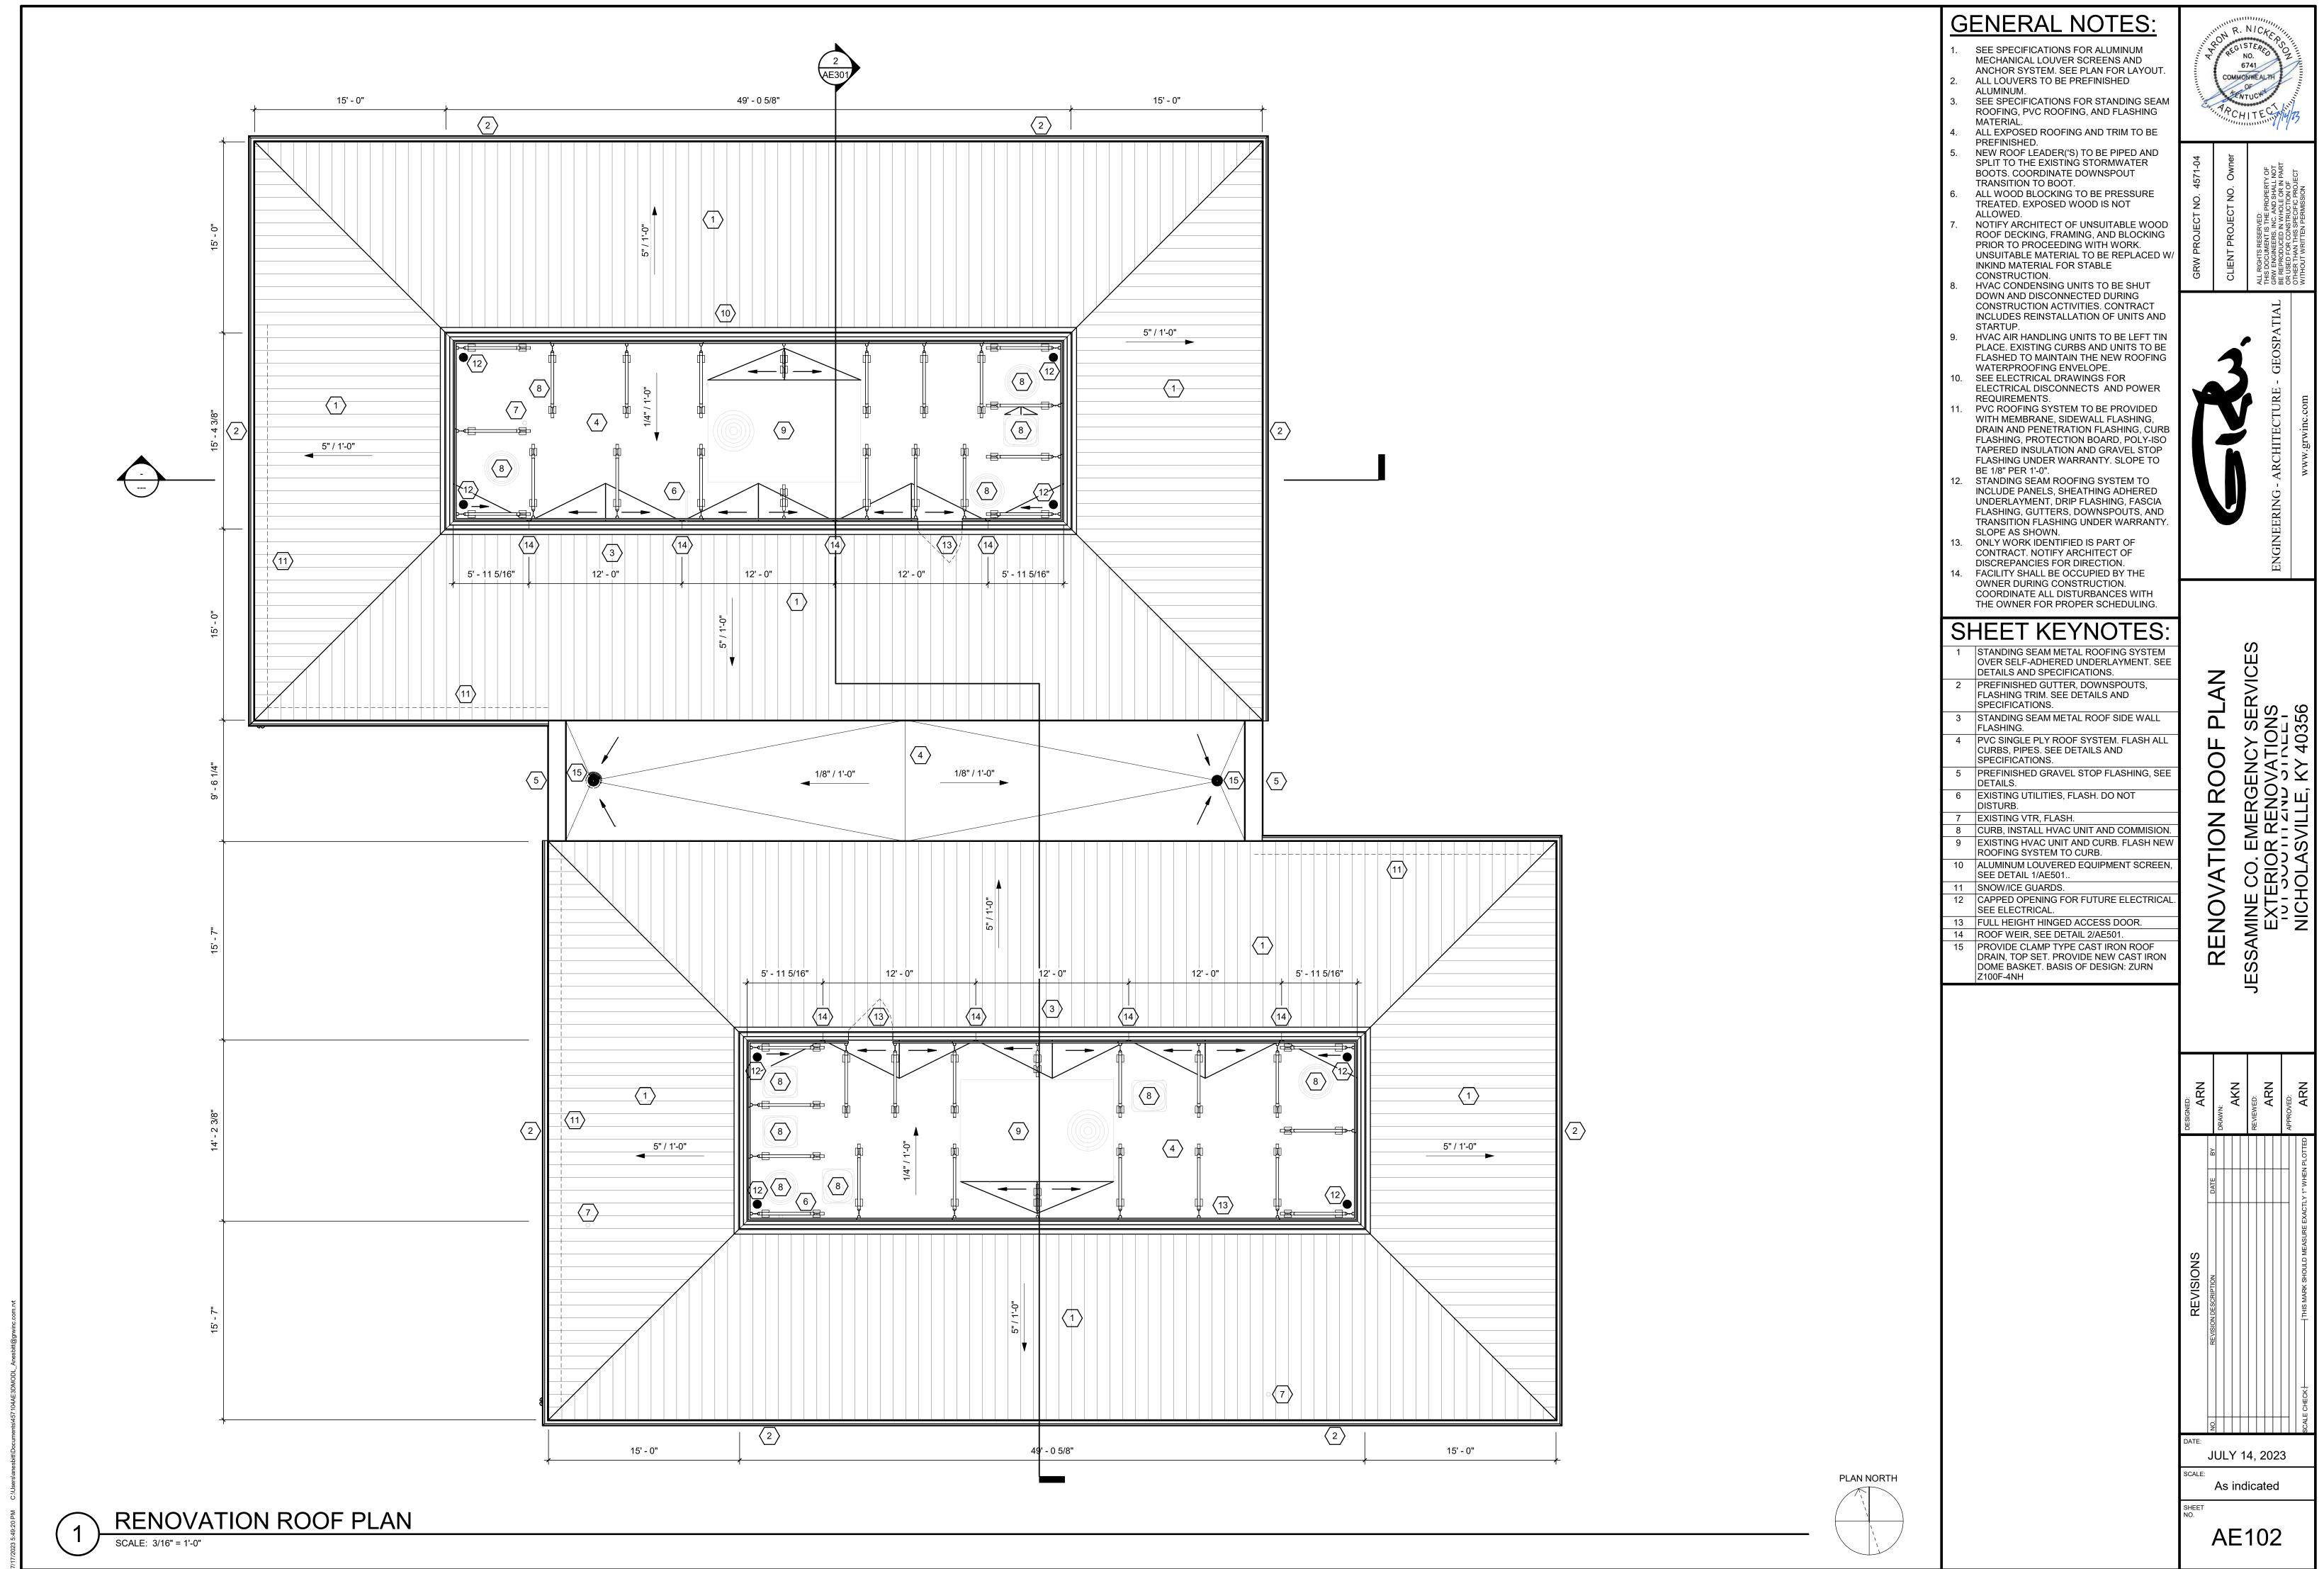


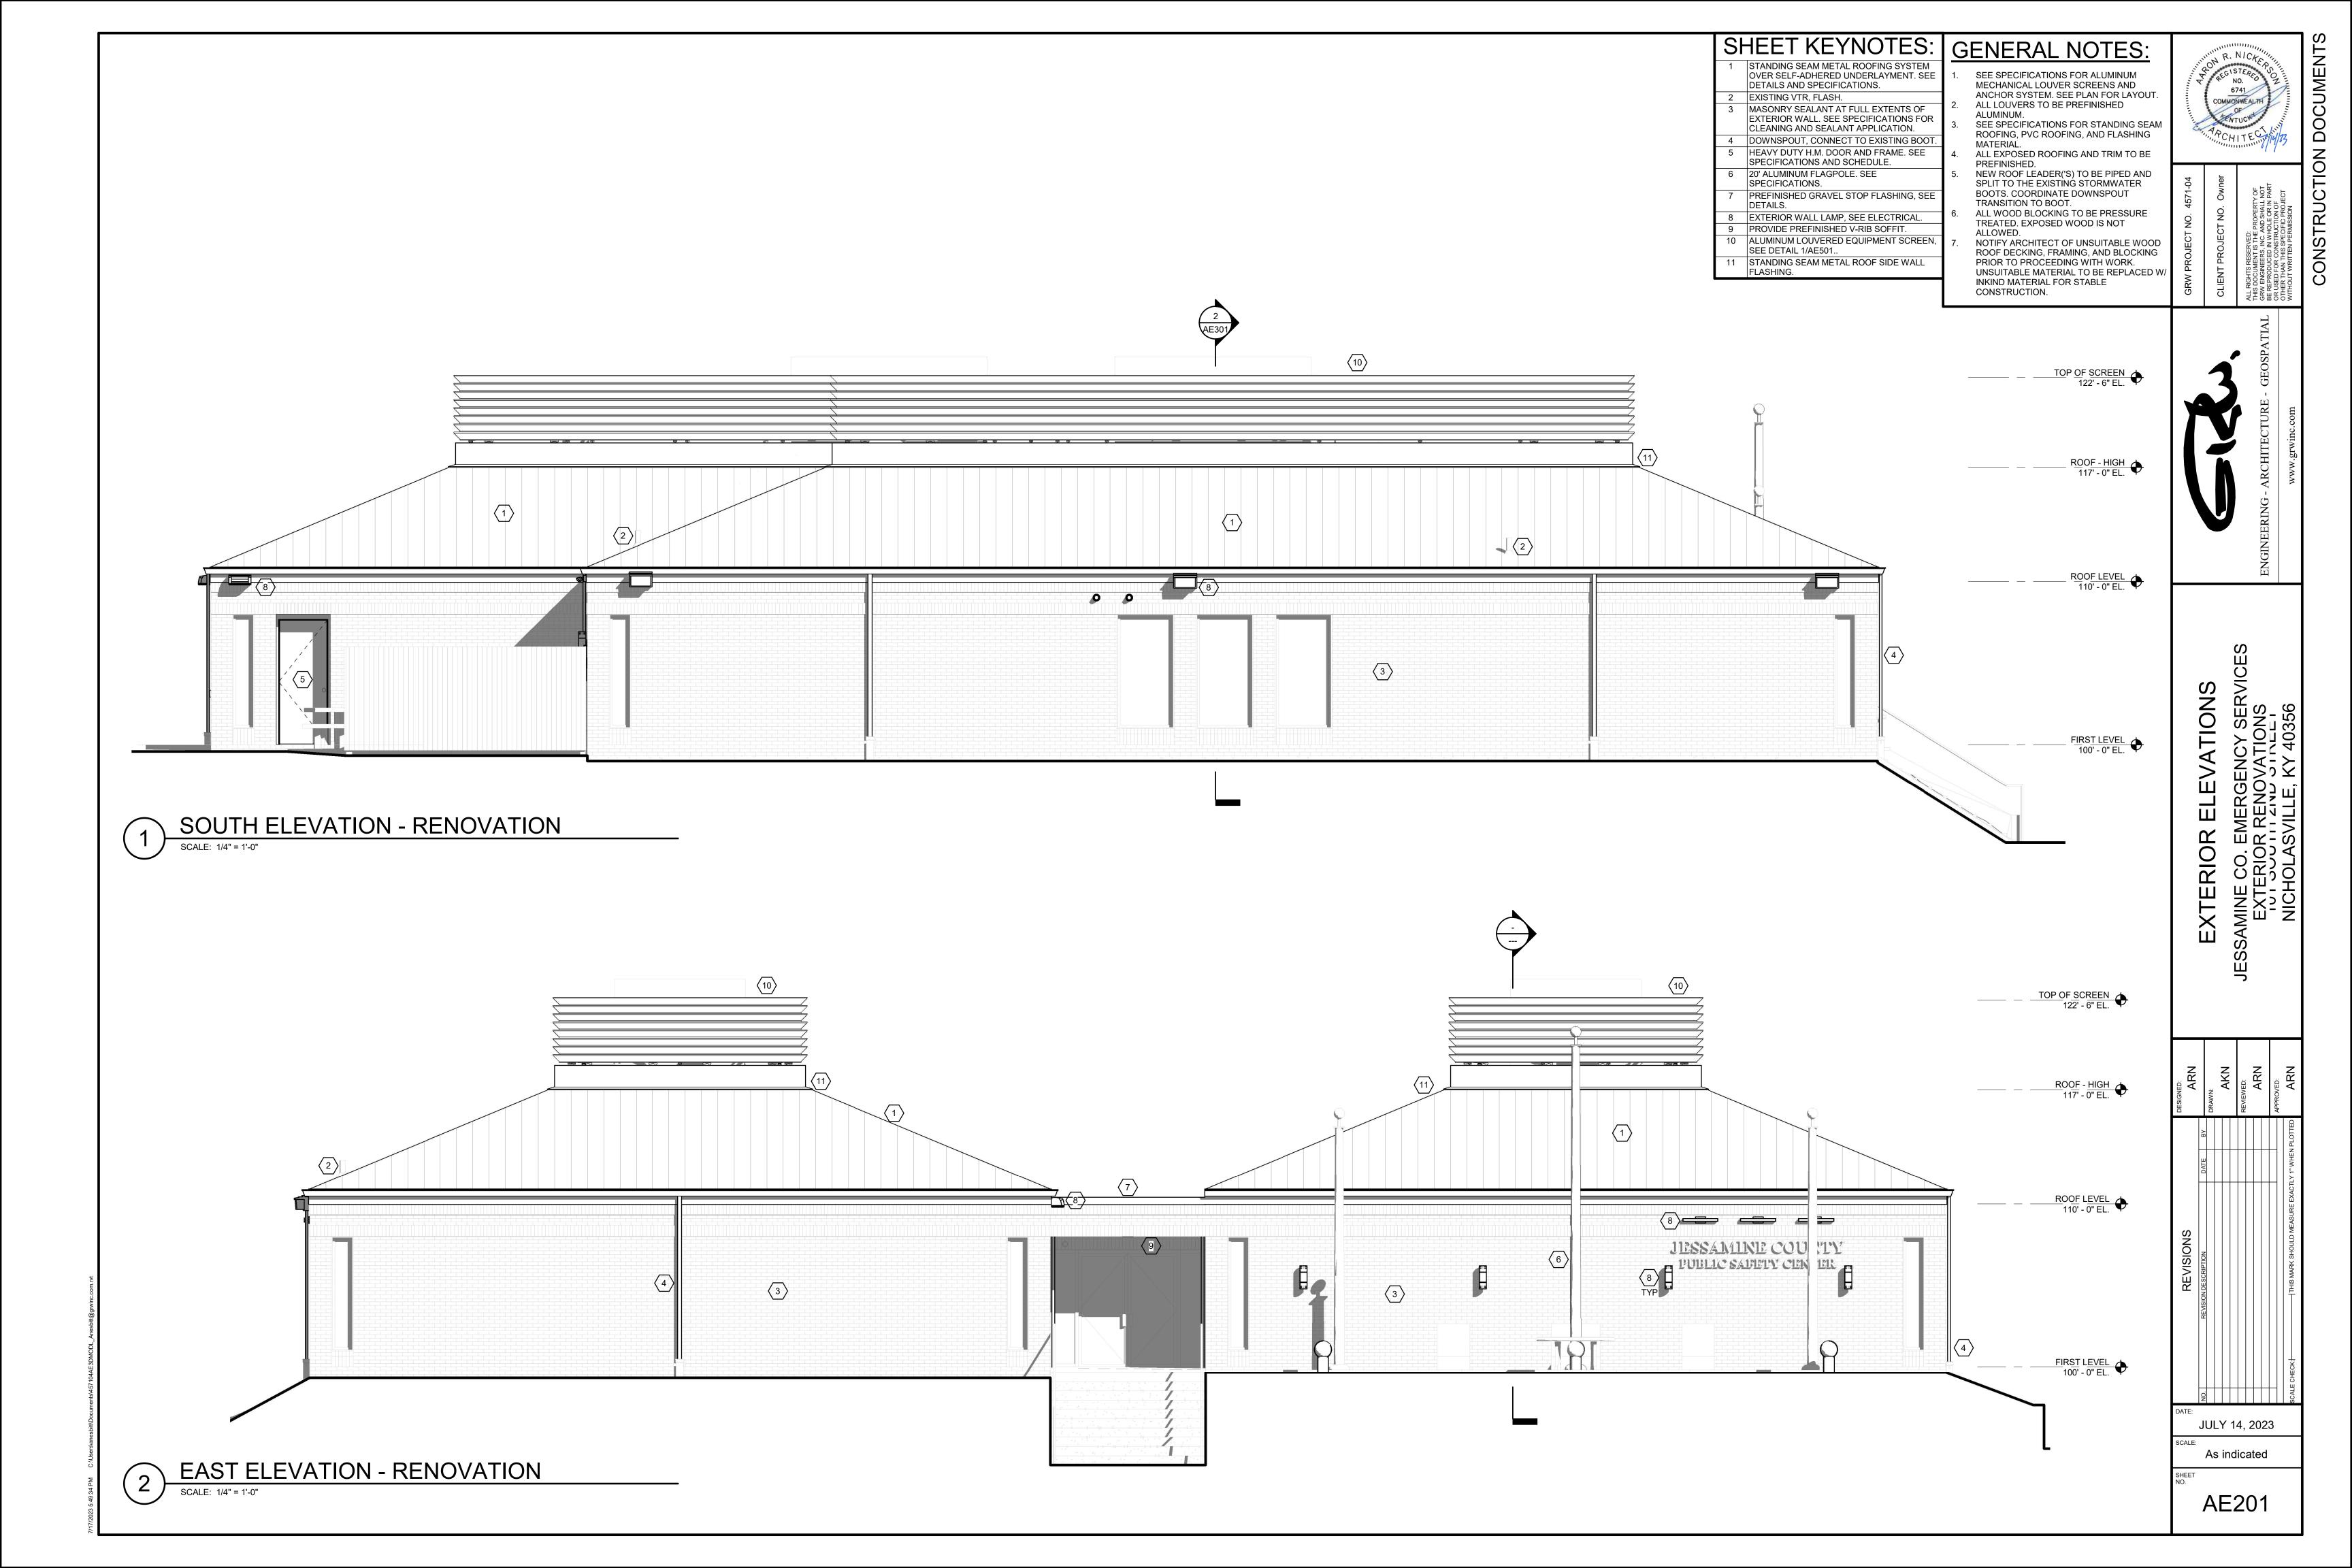

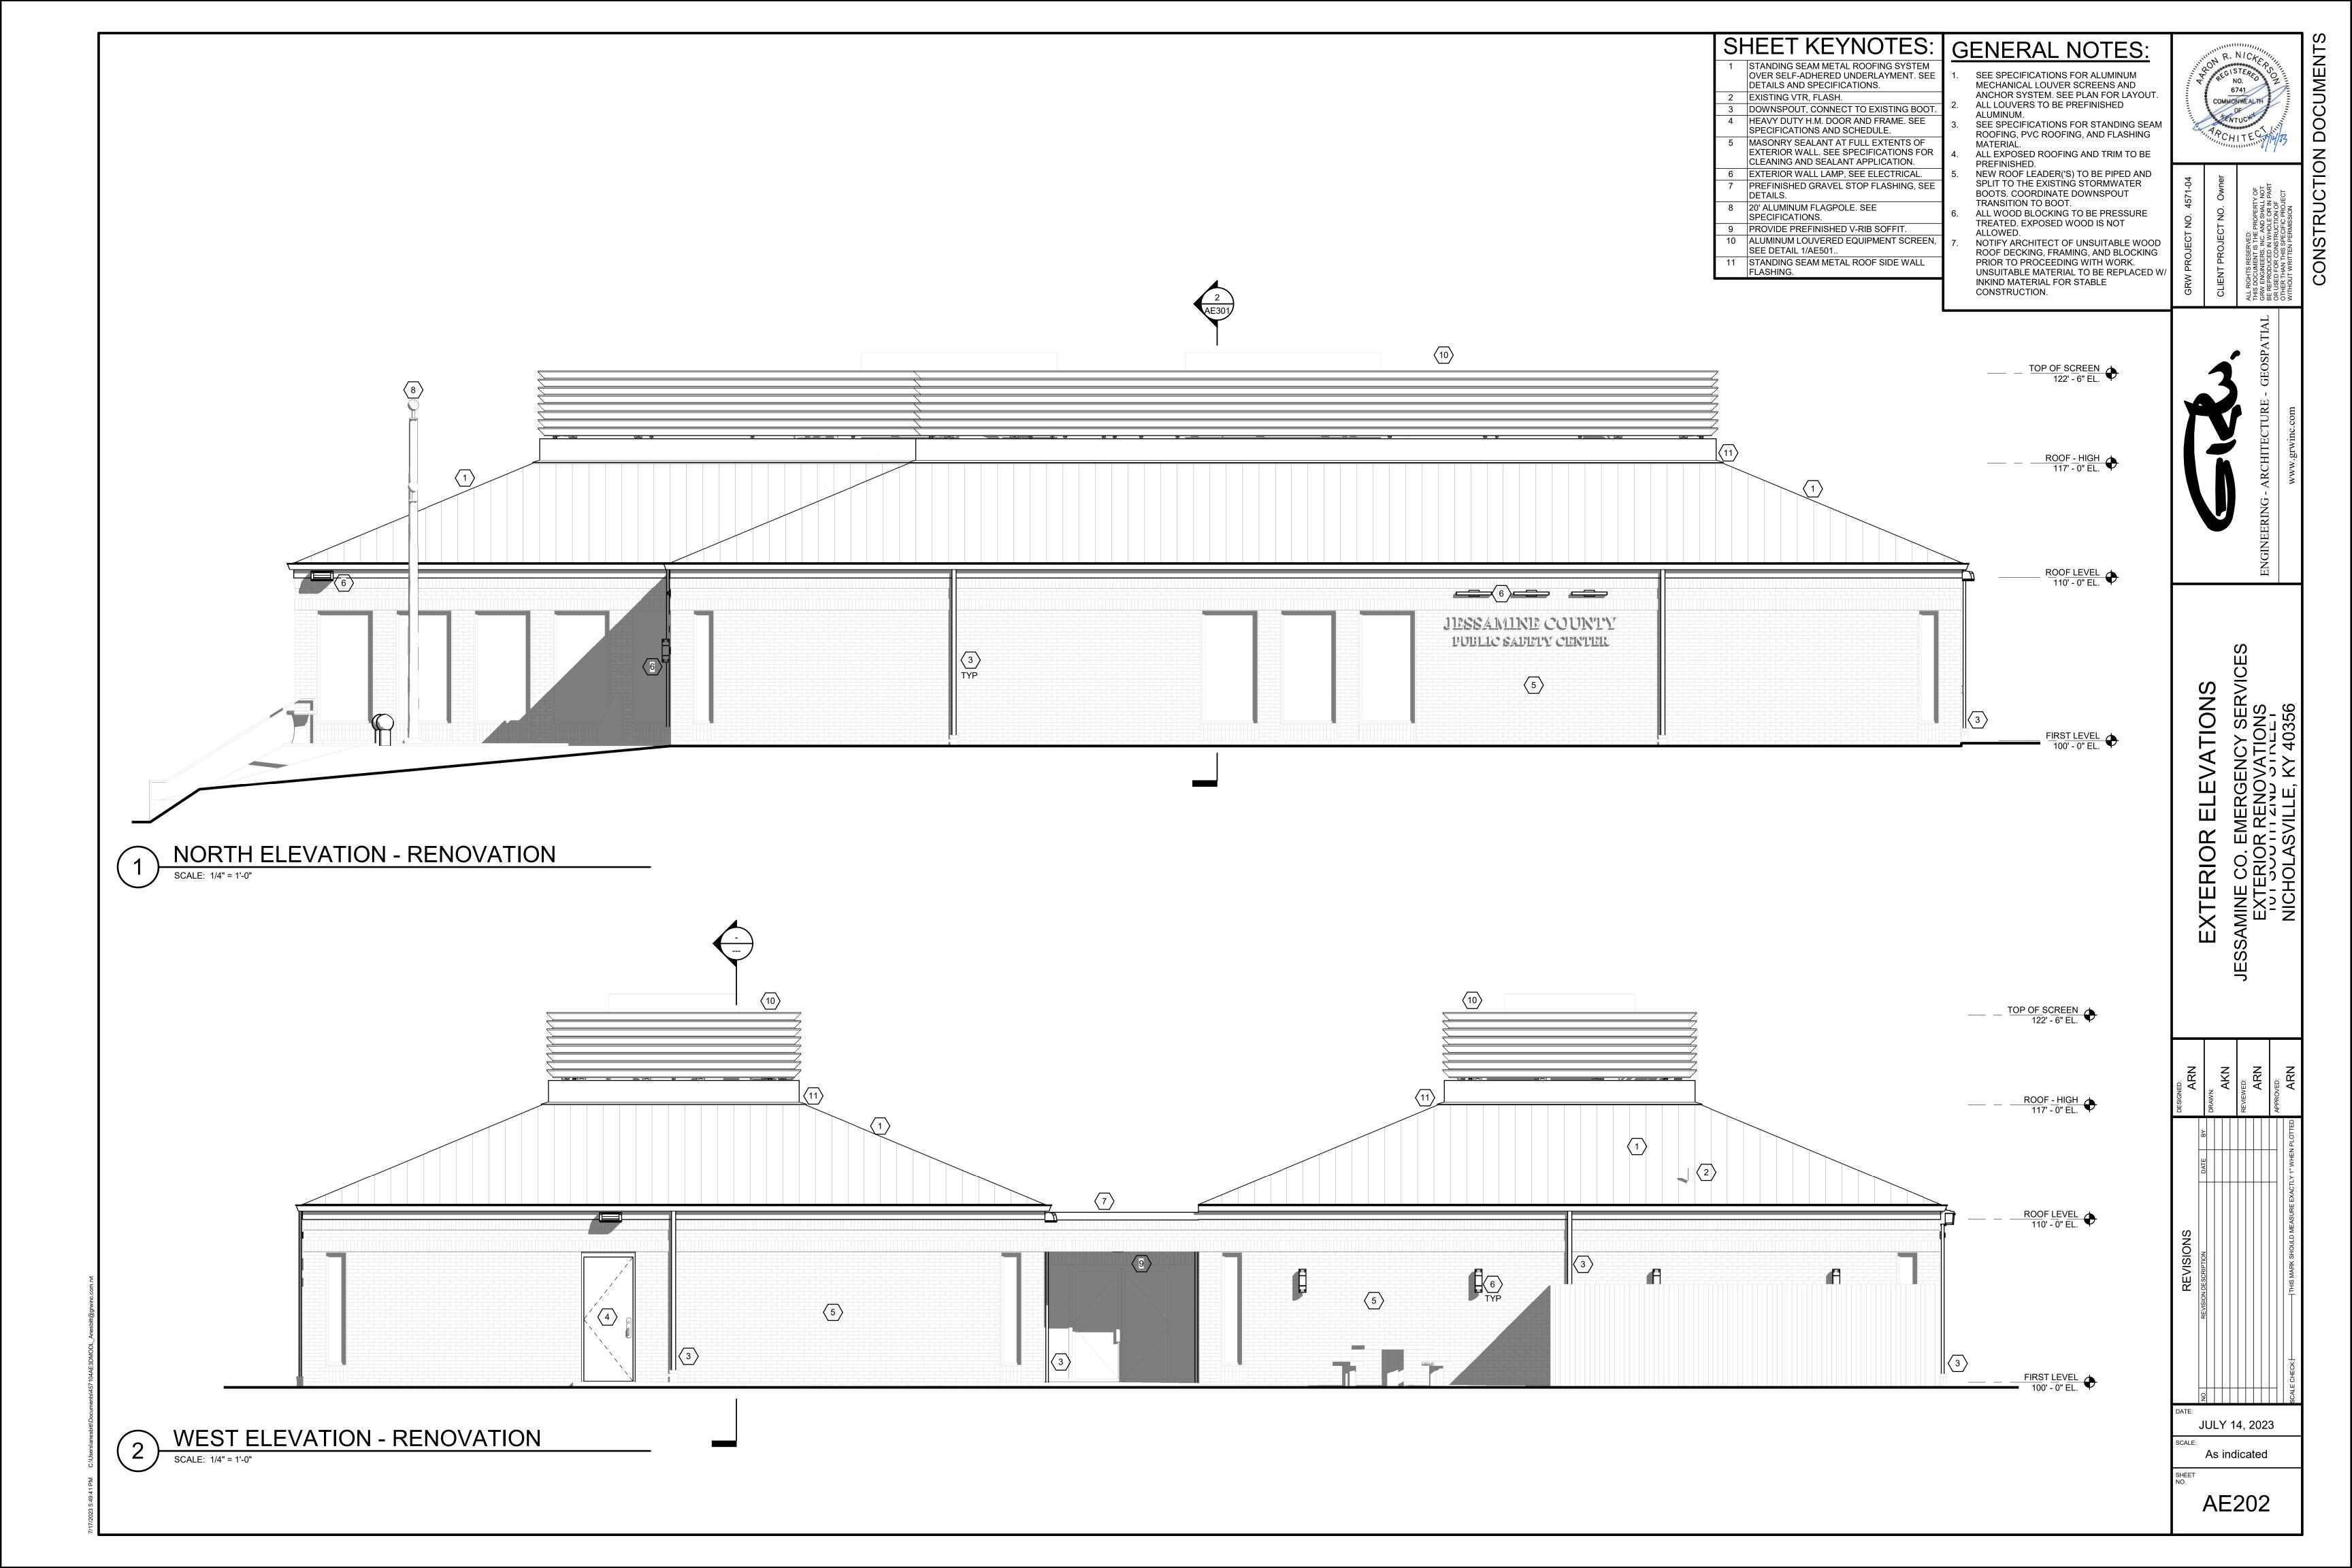

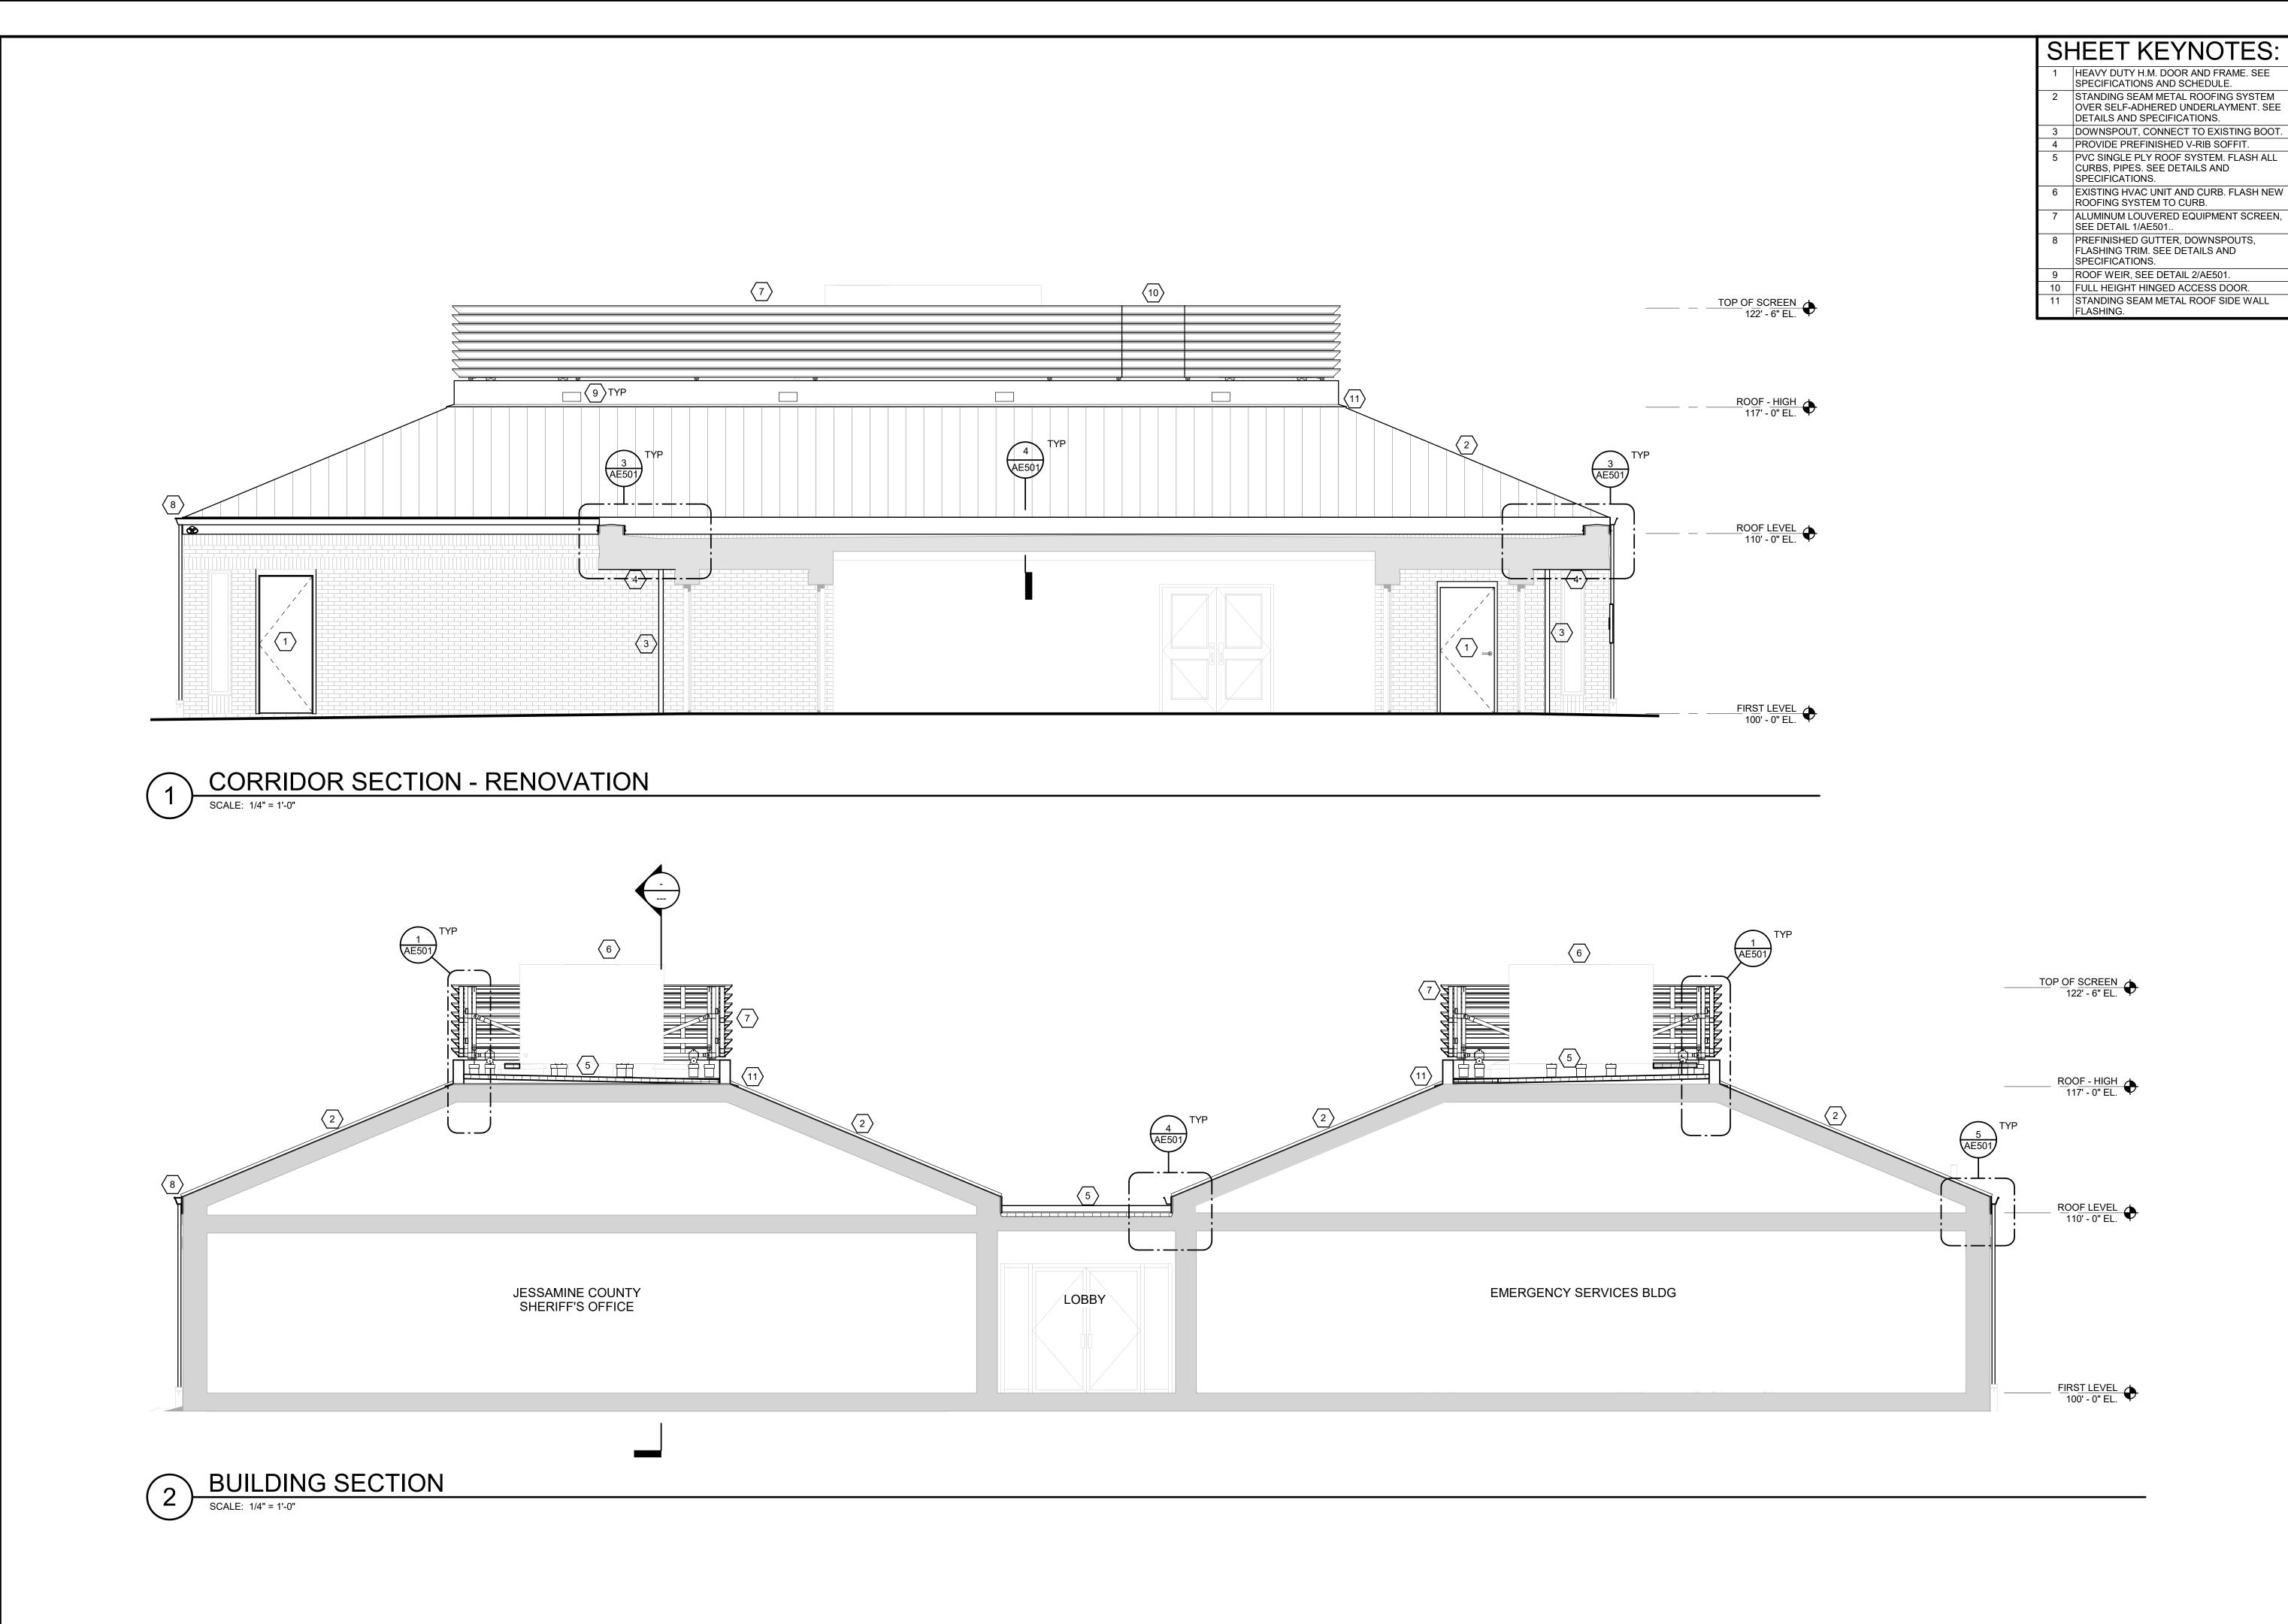

JULY 14, 2023 1/4" = 1'-0" AE301

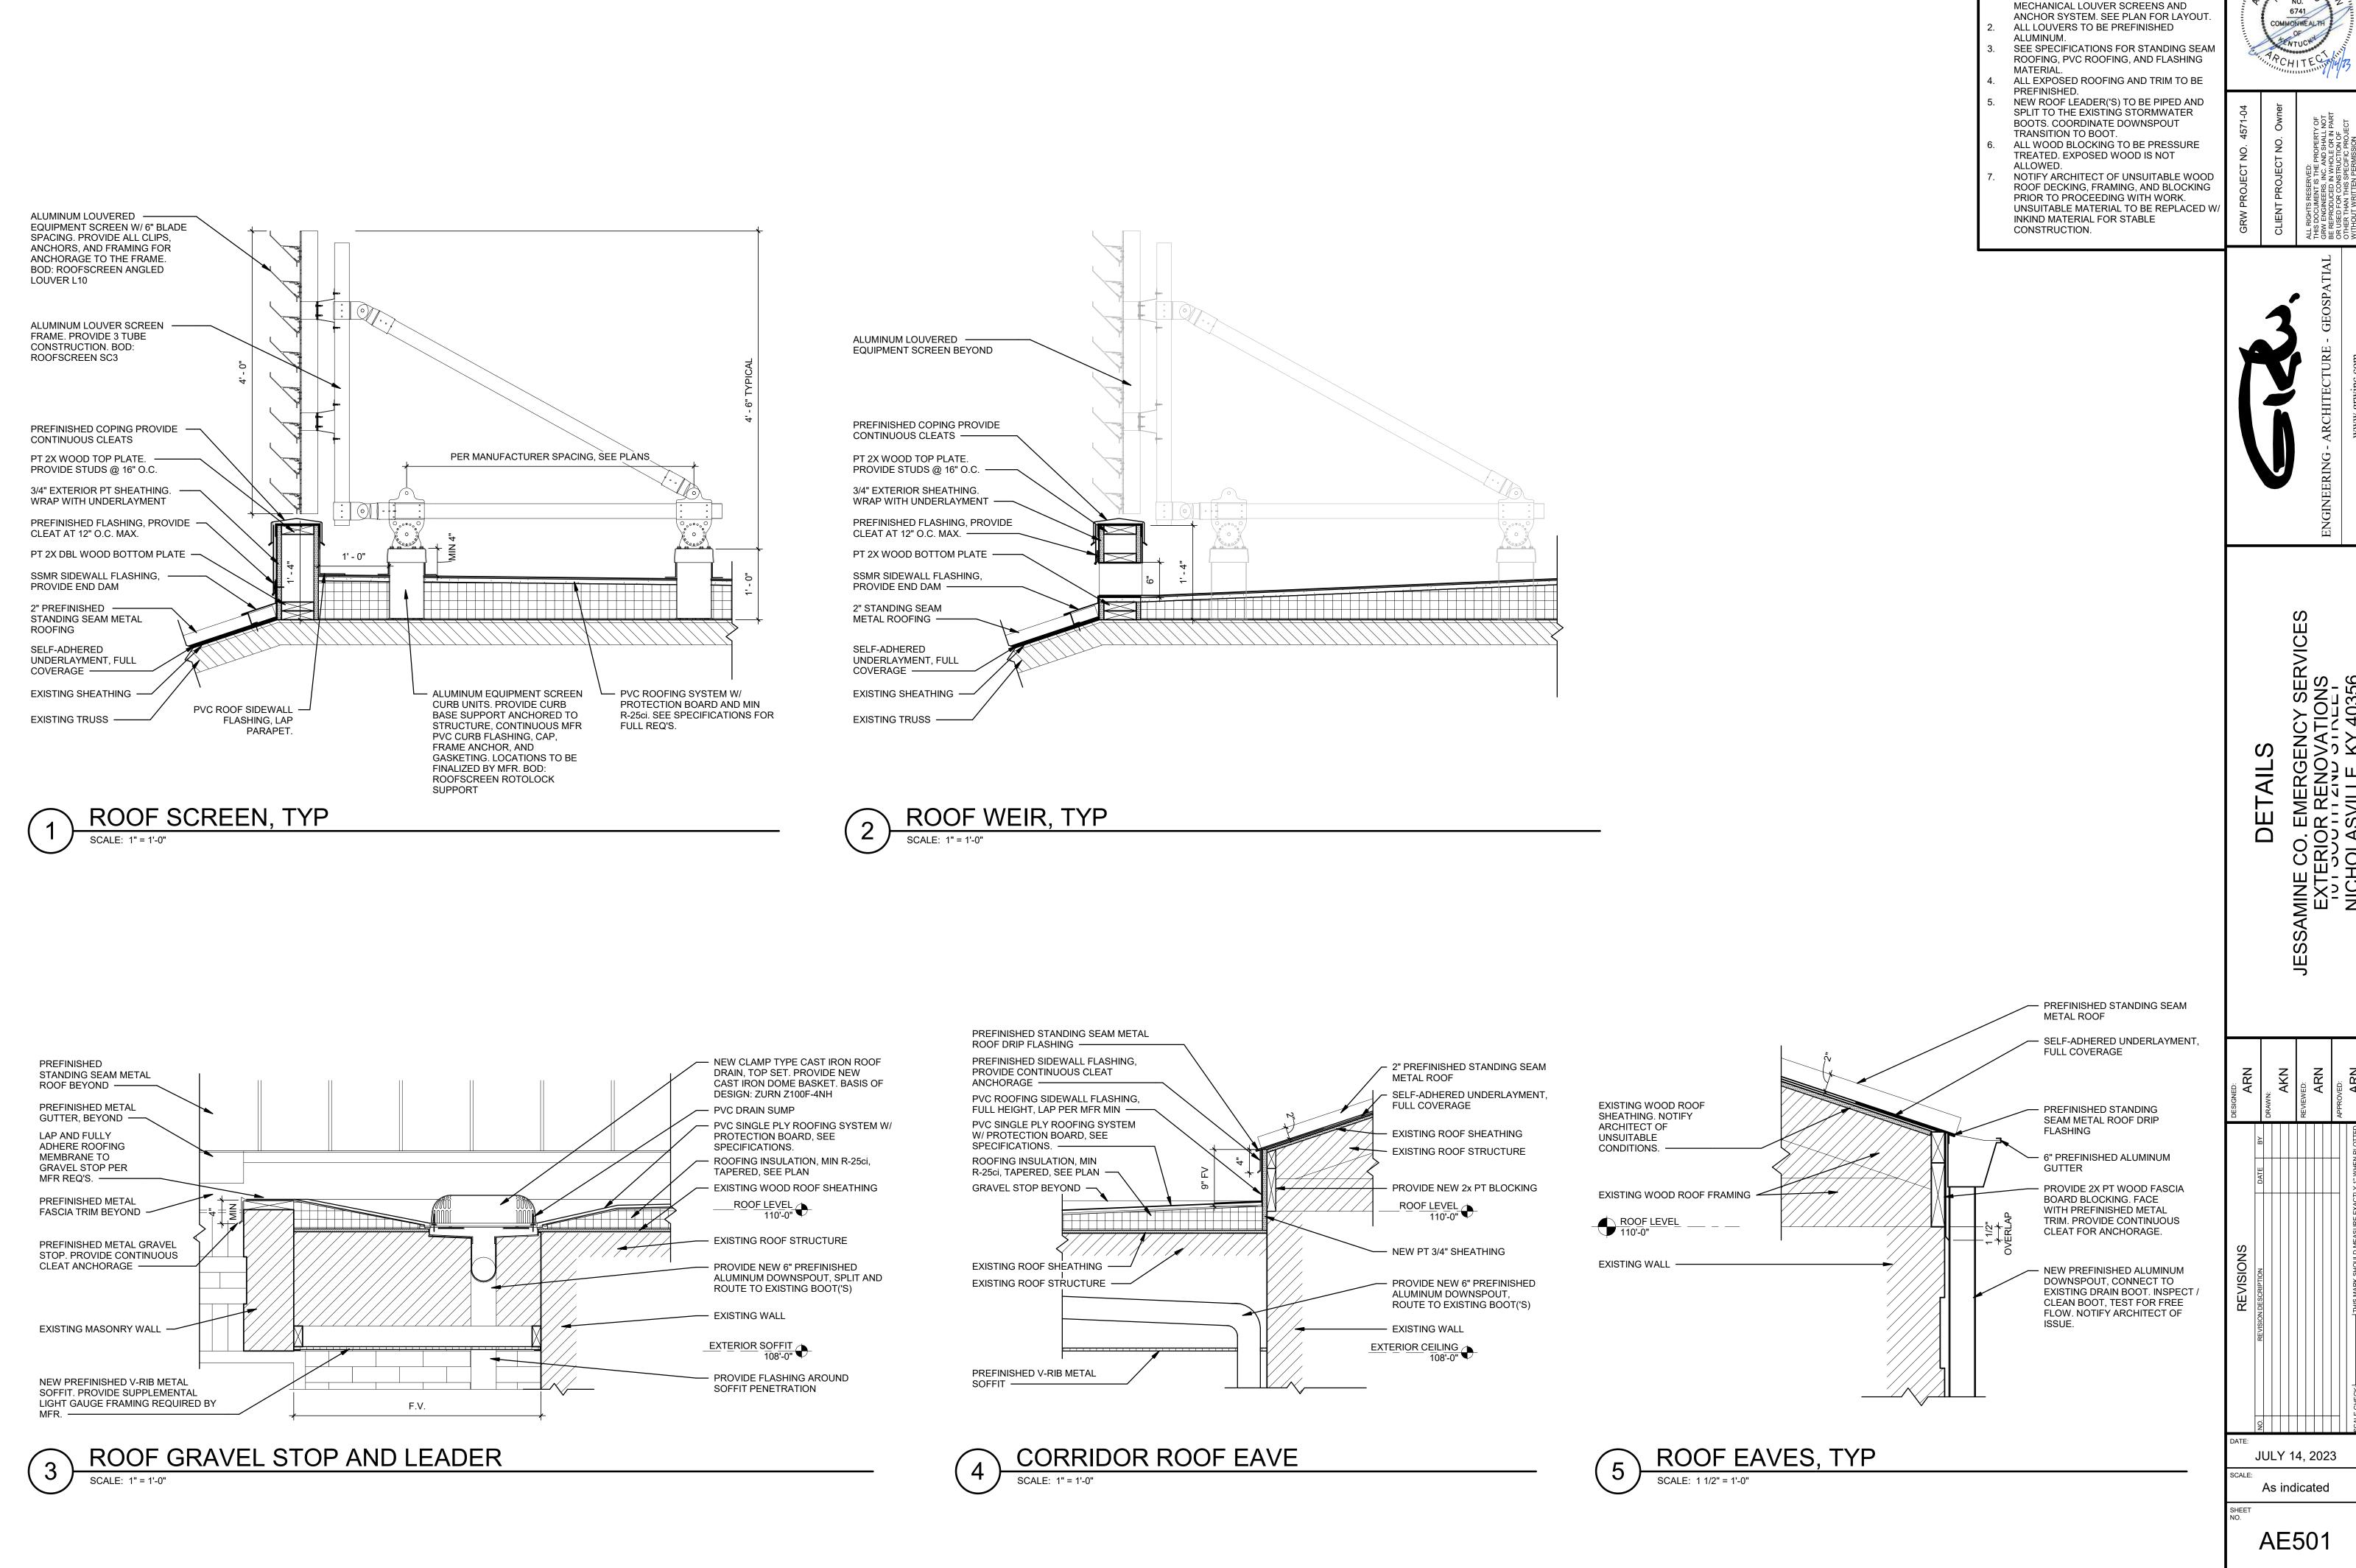

GENERAL NOTES:

SEE SPECIFICATIONS FOR ALUMINUM

DOOR SCHED


JULY 14, 2023 As indicated

AE601


GENERAL NOTES:


<u> </u>	ENERAL NOTES.
1.	SEE SPECIFICATIONS FOR DOOR / FRAME /
	HARDWARE REQUIREMENTS.
2.	COORDINATE WITH EXISTING ELECTRONIC
	/ HARDWARE AT DOOR LOCATIONS.
3.	ALL DOORS / FRAMES TO BE PAINTED, SEE
	SPECIFICATIONS.


							DO	OR AN	ID FRAME		EDULE			
							טט	OK AI						
	DOOR IDENTIFIC	CATION			DC	OOR					FRAME		HARDWARE	
DOOR				SIZE			TYPE	DOOR		FRAME	DET	AIL		
MARK	FROM ROOM	TO ROOM	WIDTH	HEIGHT	THICKNESS	DOOR MATERIAL	MARK	GLAZING	FRAME MATERIAL	TYPE	HEAD DETAIL	JAMB DETAIL	SET NUMBER	COMMENTS
101	JESSAMINE COUNTY SHERIFF'S OFFICE	EXTERIOR	3' - 0"	7' - 8"	1 3/4"	HOLLOW METAL	D1	NA	HOLLOW METAL	F1	3/AE601	4/AE601	HW-1	
102	JESSAMINE COUNTY SHERIFF'S OFFICE	EXTERIOR	3' - 0"	7' - 8"	1 3/4"	HOLLOW METAL	D1	NA	HOLLOW METAL	F1	3/AE601	4/AE601	HW-2	
103	VESTIBULE	JESSAMINE COUNTY SHERIFF'S OFFICE	3' - 0"	7' - 0"	1 3/4"	HOLLOW METAL	D1	NA	HOLLOW METAL	F1	3/AE601	4/AE601	HW-3	

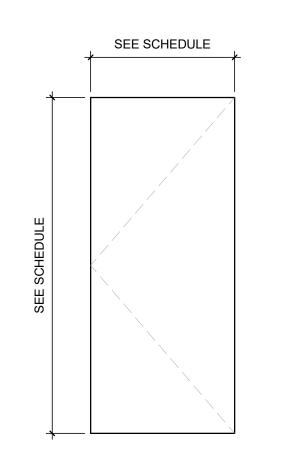


DOOR TYPES

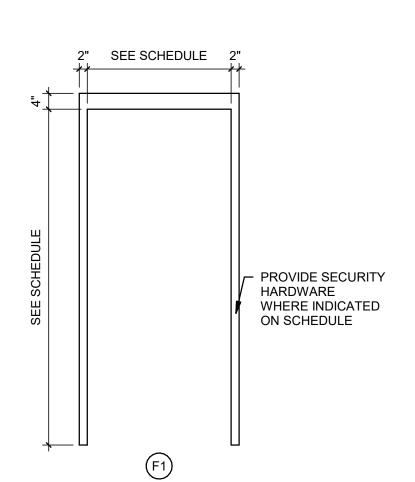

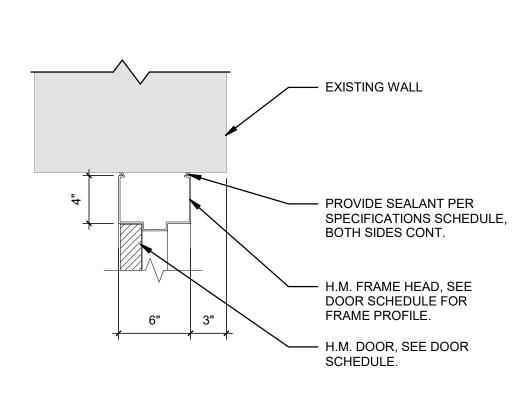


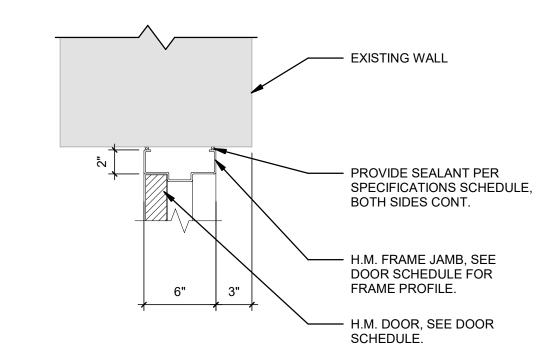



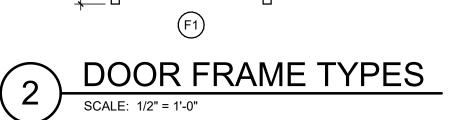



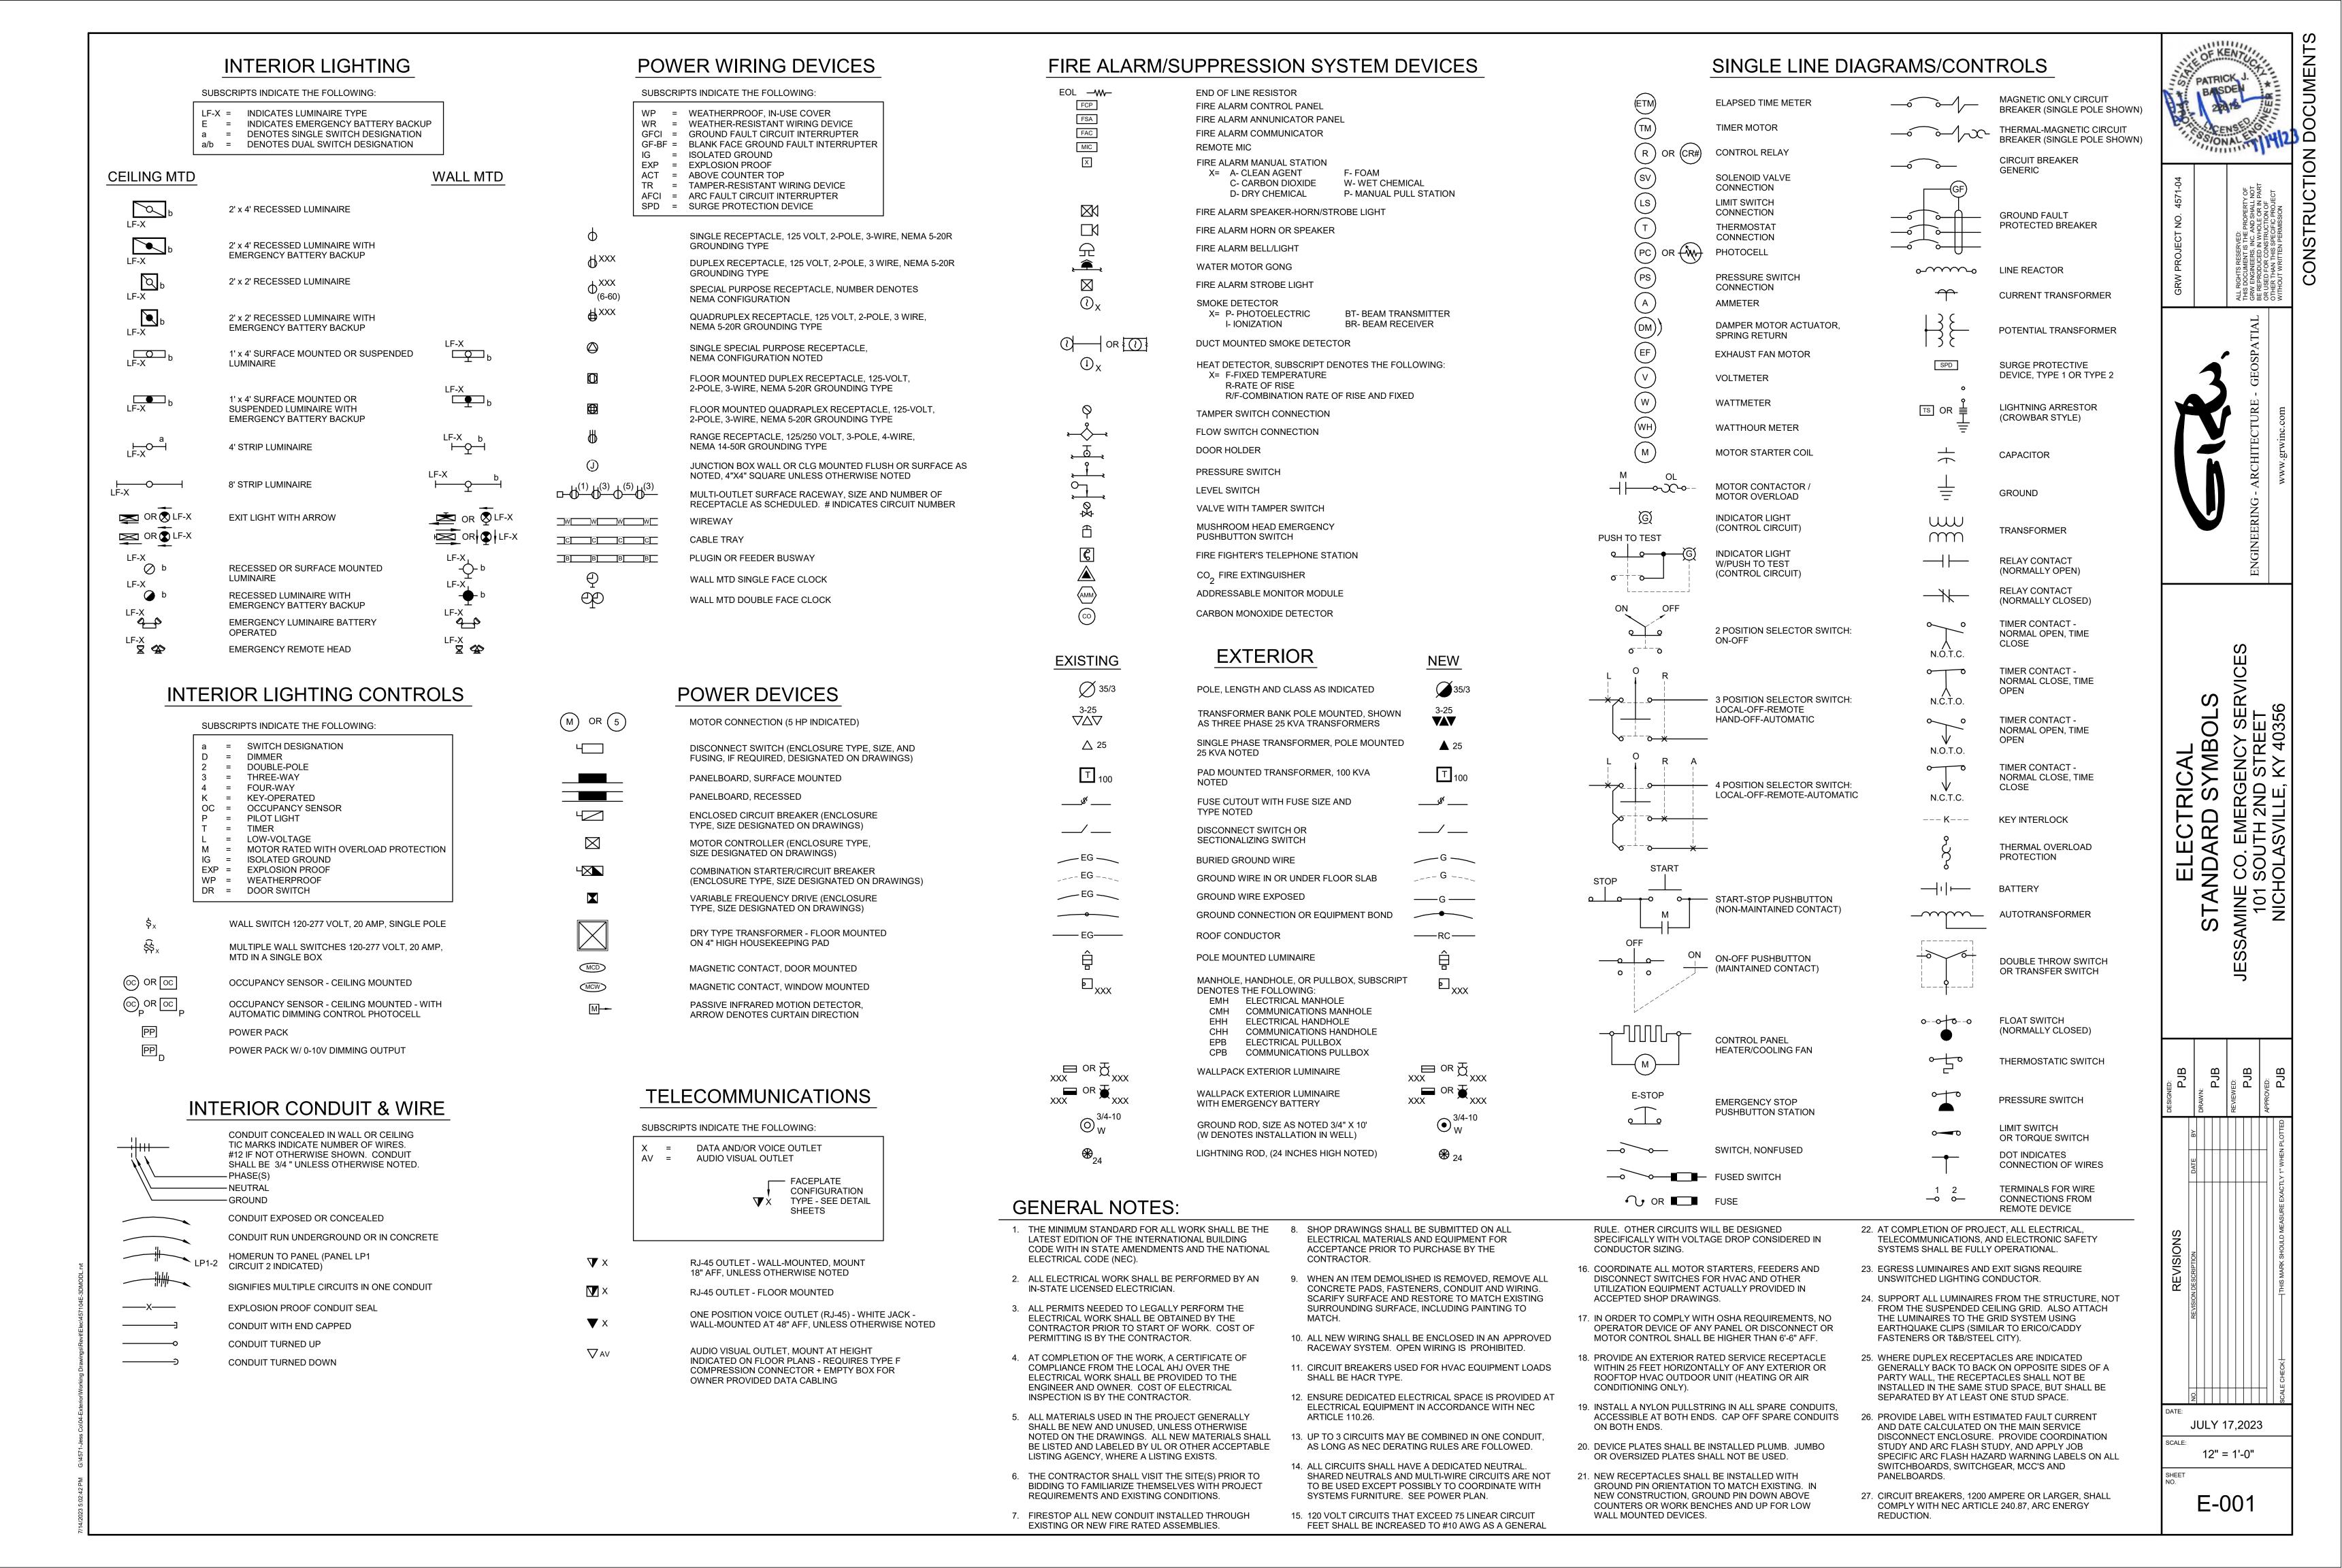

ELECTRICAL
DEMOLITION FLOOR PLAN
JESSAMINE CO. EMERGENCY SERVICES
101 SOUTH 2ND STREET
NICHOLASVILLE, KY 40356

JULY 17,2023 3/16" = 1'-0"

ED101

ELECTRICAL EQUIPMENT / DEVICES FOR REMOVAL. CONTRACTOR SHALL COORDINATE WITH OTHER TRADES FOR THE DEMOLITION AND PROPER DISPOSAL OF THE

WHERE CONDUIT HAS BEEN REMOVED THROUGH AN EXISTING FIRE RATED CONSTRUCTION, THE CONTRACTOR SHALL PROPERLY SEAL UNUSED PENETRATIONS TO

ALL DEMOLITION WORK SHALL BE COORDINATED WITH ALL OTHER WORK AND EXISTING CONDITIONS TO ASSURE PROPER REMOVAL OF EXISTING ELECTRICAL WORK.

6 WHERE NEW LUMINAIRES ARE TO REPLACE EXISTING LUMINAIRES AT THE SAME LOCATION, CONTRACTOR SHALL REUSE THE EXISTING BACKBOX AND CONDUIT, WHERE

ANTENNA(S) AND ASSOCIATED ANTENNA SUPPORT. REMOVE AND PROPERLY DISPOSE OF THE ASSOCIATED

2 CONTRACTOR SHALL DISCONNECT THE ELECTRICAL SERVICE TO THE EXISTING AIR HANDLER.

3 CONTRACTOR SHALL DISCONNECT THE ELECTRICAL SERVICE TO THE EXISTING CONDENSING UNIT. 4 CONTRACTOR SHALL DISCONNECT THE ELECTRICAL

SERVICE TO THE EXISTING EXHAUST FAN (OR ROOF HOOD).

EXISTING CONDUIT MAST FOR ANTENNA CABLING TO

INDICATED ELECTRICAL DEVICES.

MARKED AS "SPARE".

CABLING.

REMAIN.


MAINTAIN THE EXISTING FIRE RATINGS.

4 CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE DEMOLITION OF ANY WORK. EXISTING CIRCUITS NOT REUSED FOR NEW DEVICES / EQUIPMENT SHALL BE REMOVED TO ASSOCIATED ELECTRICAL PANEL AND MARK BREAKERS SHALL BE

JULY 17,2023

3/16" = 1'-0"

ED102

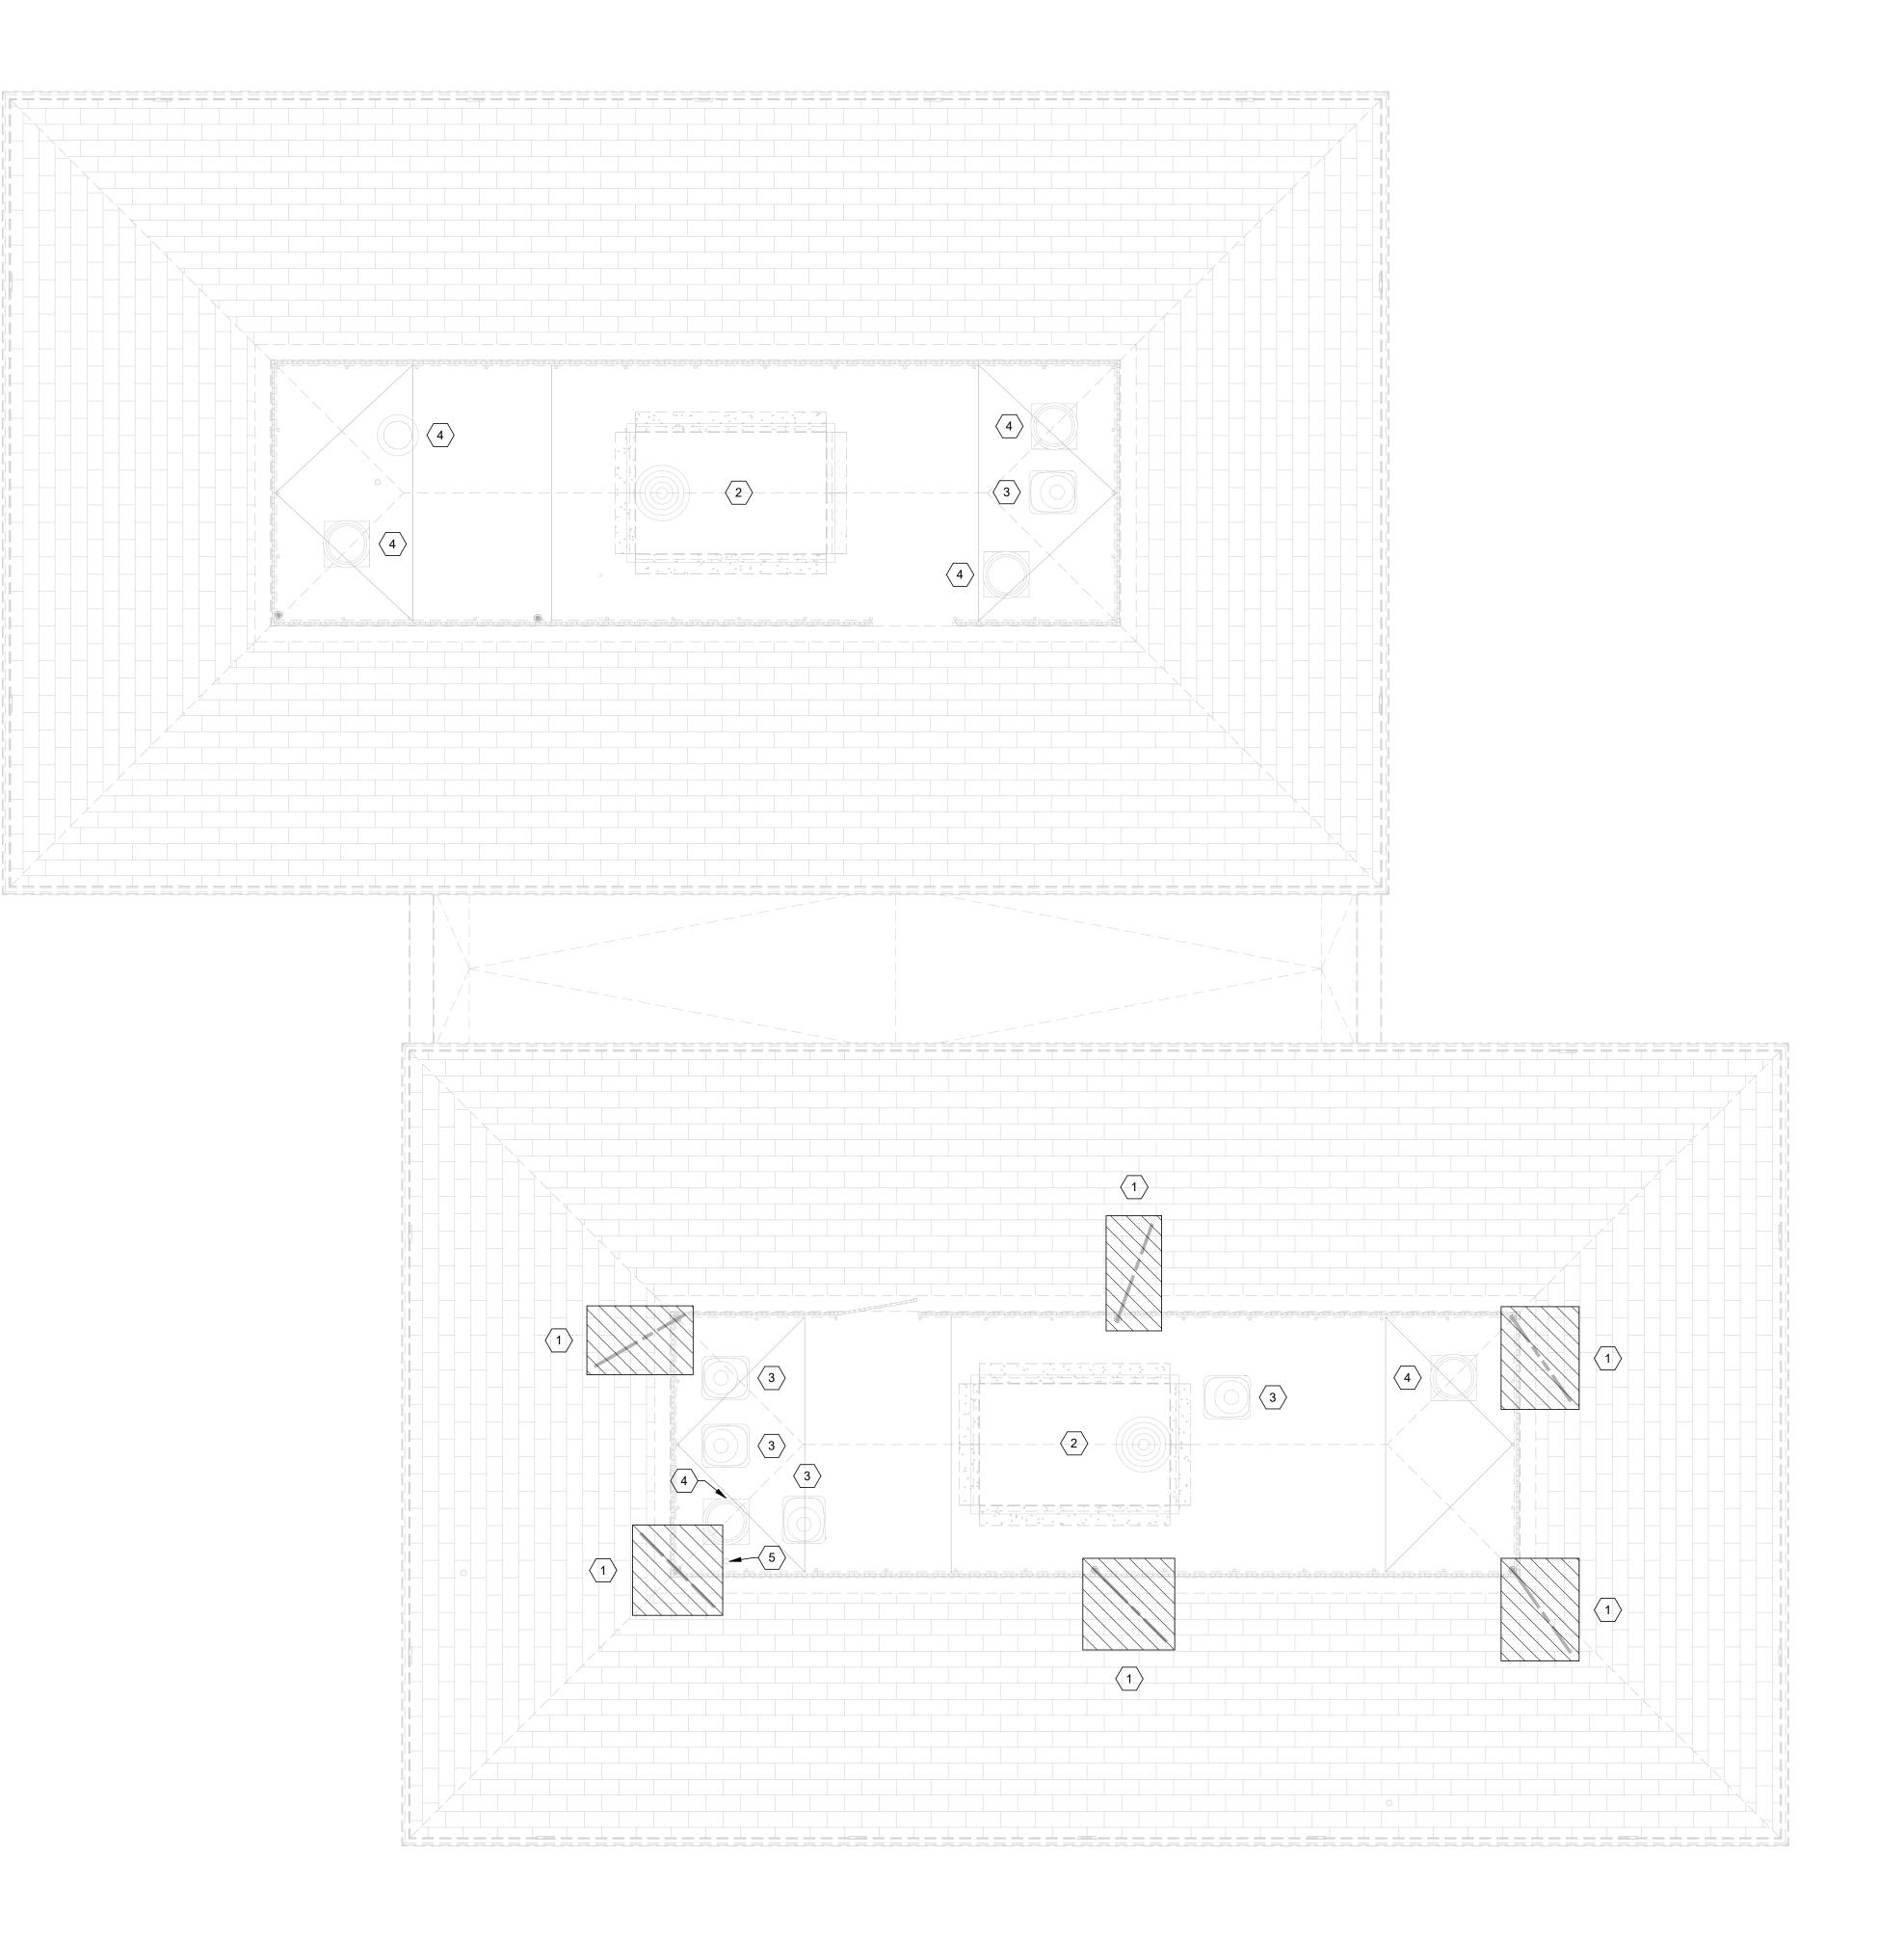

ELECTRICAL RENOVATION FLOOR PLAN

JULY 17,2023 3/16" = 1'-0"

E-101

MOUNT PHOTOCELL TO INSIDE EQUIPMENT SCREEN. PROVIDE 3#12, 1#12 GND, 3/4"C TO 3-POSITION SWITCH (SHEET E-101).

PROVIDE 2" CONDUIT FROM ROOF TO ABOVE LAY-IN CEILING BELOW. PROPERLY SEAL CONDUIT PENETRATION AND CAP CONDUIT ON ROOF.


3 CONTRACTOR SHALL RECONNECT THE ELECTRICAL SERVICE TO THE EXISTING EXHAUST FAN (OR ROOF HOOD).

4 CONTRACTOR SHALL RECONNECT THE ELECTRICAL SERVICE TO THE EXISTING CONDENSING UNIT. CONTRACTOR SHALL ADJUST DISCONNECT SWITCH AS REQUIRED FOR INSTALLATION OF NEW EQUIPMENT SCREEN SUPPORT FRAMES.

CONTRACTOR SHALL RECONNECT THE ELECTRICAL SERVICE TO THE EXISTING AIR HANDLER.

JULY 17,2023

3/16" = 1'-0" E-102

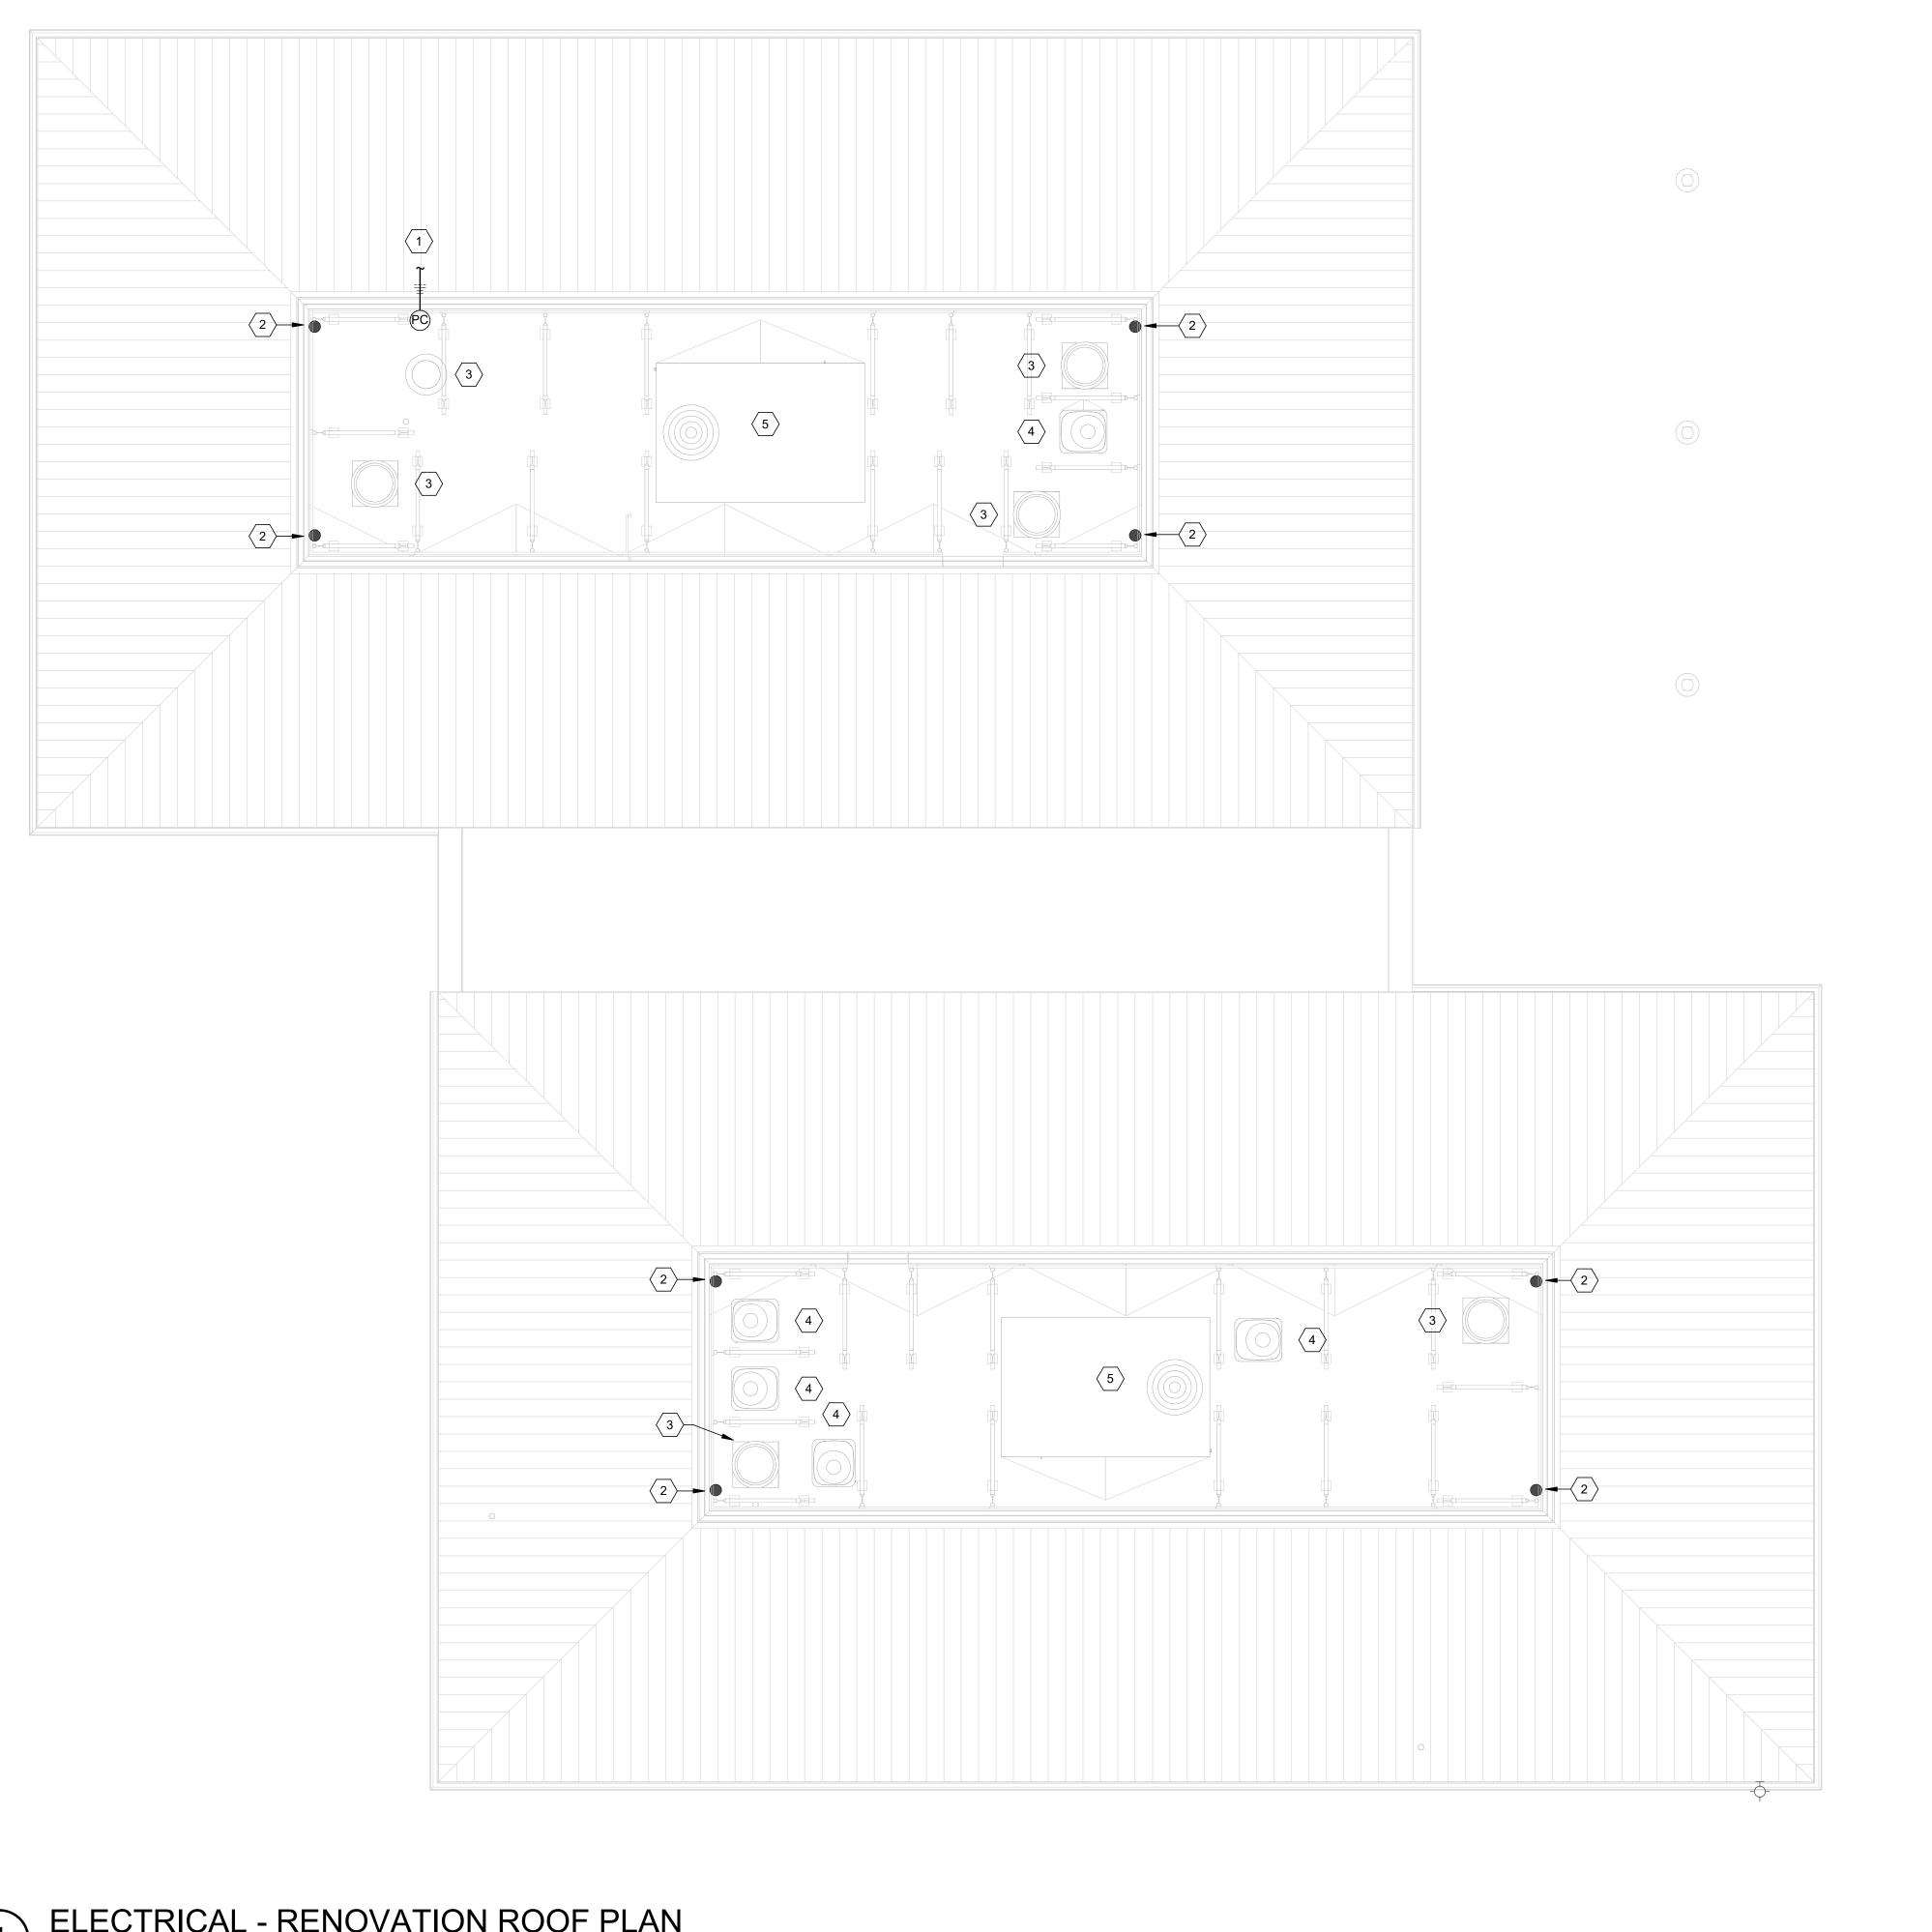

_		_			_		
ВУ						EN PLOTTE	
DATE						ЗТГҮ 1" WHI	
REVISION DESCRIPTION						E CHECK:	

JULY 17,2023

12" = 1'-0"

E-501

DESIGNED: PJB		DRAWN:	<u>!</u>	PJB	REVIEWED:	PJB	APPROVED: PJB				
	ВУ									EN DI OTTE	EN FLOTTE
	DATE									1 W "1 V II.	- ^ -
REVISIONS	REVISION DESCRIPTION									THIS MAPK SHOLLED MEASURE EXACTLY VILWHEN BLOTTER	



VERRIDE SELECTOR SWITE - MOUNTED IN ELECTRICA ROOM	CH AL				
H O A					
	BUILDING MOUNTED PHOTOCELL				
ōō <u>*</u>					
	·	' 			
	·		EXTERIOR BUILDING MOUNTED LIGHTING - EAST		
			EXTERIOR BUILDING MOUNTED LIGHTING - WEST		

MODEL NUMBER


RWL1 48L-25 4K6 4W UNV BLS EH SP

RWL1 48L-45 4K6 4W UNV BLS SP

LOWELL 2/9LED38 40K 120 NFL CN5 BRS

HH6-LED 1200L DIM10 MVOLT 40K EMG-LED-20W HH6-6501 CL-WH

INT 2 34L-30 4K8 WW UNV A12

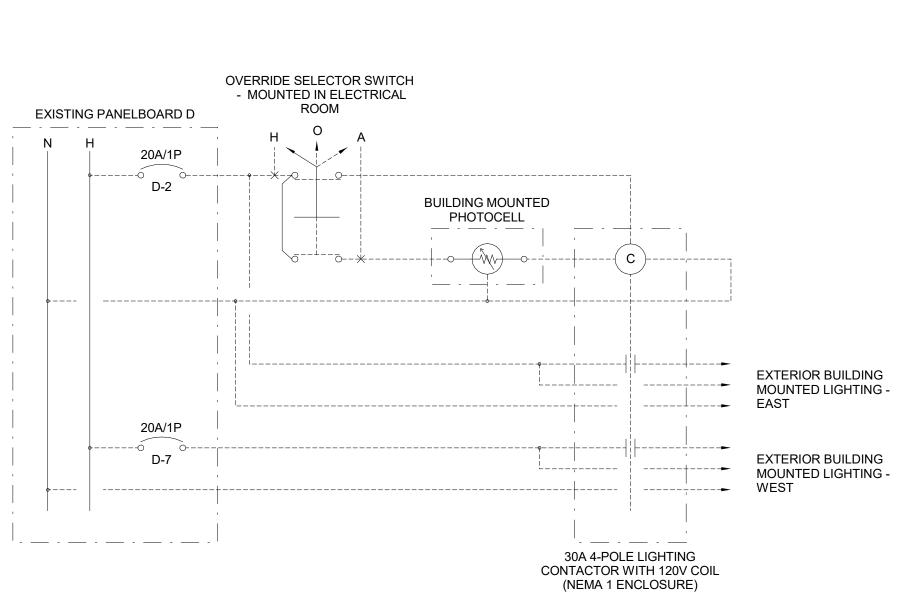

LUMINAIRE SCHEDULE

120 V

120 V

120 V

120 V

120 V

MOUNTING TYPE

WALL

RECESSED

MOUNTING HEIGHT

MATCH EXISTING

MATCH EXISTING

MATCH EXISTING

8'-0" SEE ARCHITECTURAL MANUFACTURER

BEACON OR APPROVED EQUIVALENT

BEACON OR APPROVED EQUIVALENT

HYDREL OR APPROVED EQUIVALENT

ELITE LIGHTING OR APPROVED EQUIVALENT

KIM LIGHTING OR APPROVED EQUIVALENT

COLOR TEMP LAMP TYPE LUMENS

LED

LED

3680

5704

1422

3297

28 W

47 W

11 W

30 W

4000 K

4000 K

4000 K

4000 K

4000 K

DESCRIPTION

LED WALL LUMINAIRE WITH INTEGRAL EMEGENCY BATTERY BACKUP

6" LED DOWNLIGHT WITH INTEGRAL EMERGENCY BATTERY BACKUP

LED WALL LUMINAIRE WITH INDIRECT / DIRECT LIGHTING

OLF-2

OLF-4E

LED WALL LUMINAIRE

LED FLOODLIGHT LUMINAIRE

